

NRC Docket No: 50-295

50-304

ZION NUCLEAR POWER STATION UNITS 1 and 2

Annual Radiological
Environmental Operating Report

1 January Through 31 December 2010

Prepared By

Teledyne Brown Engineering
Environmental Services



Zion Nuclear Power Station
Zion, IL 60099

May 2011

Table Of Contents

I. Summary and Conclusions.....	1
II. Introduction	3
A. Objectives of the REMP	3
B. Implementation of the Objectives.....	3
III. Program Description	3
A. Sample Collection	3
B. Sample Analysis.....	5
C. Data Interpretation	5
D. Program Exceptions.....	6
E. Program Changes	7
IV. Results and Discussion	7
A. Aquatic Environment	7
1. Public Water	7
2. Fish	8
3. Sediment.....	8
B. Atmospheric Environment	8
1. Airborne	8
a. Air Particulates.....	8
C. Ambient Gamma Radiation.....	9
D. Land Use Survey.....	9
E. Summary of Results – Inter-laboratory Comparison Program.....	10

Appendices

Appendix A Radiological Environmental Monitoring Report Summary

Tables

Table A-1 Radiological Environmental Monitoring Program Quarterly and Annual Summaries for the Zion Nuclear Power Station, 2010

Appendix B Location Designation, Distance & Direction, and Sample Collection & Analytical Methods

Tables

Table B-1 Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Zion Nuclear Power Station, 2010

Table B-2 Radiological Environmental Monitoring Program - Summary of Sample Collection and Analytical Methods, Zion Nuclear Power Station, 2010

Figures

Figure B-1 Inner Ring TLD Locations and Fixed Air Samplers of the Zion Nuclear Power Station, 2010

Figure B-2 Fish, Water and Sediment Locations of the Zion Nuclear Power Station, 2010

Appendix C Data Tables and Figures - Primary Laboratory

Tables

Table C-I.1 Concentrations of Gross Beta in Public Water Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010

Table C-I.2 Concentrations of Tritium in Public Water Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table C-I.3 Concentrations of Gamma Emitters in Public Water Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table C-II.1 Concentrations of Gamma Emitters in Fish Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table C-III.1 Concentrations of Gamma Emitters in Sediment Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table C-IV.1 Concentrations of Gross Beta in Air Particulate Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table C-IV.2	Monthly and Yearly Mean Values of Gross Beta Concentrations (E-3 pCi/cu meter) in Air Particulate Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.
Table C-IV.3	Concentrations of Gamma Emitters in Air Particulate Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.
Table C-V.1	Quarterly TLD Results for Zion Nuclear Power Station, 2010.
Table C-V.2	Mean Quarterly TLD Results for the Inner and Other Locations for Zion Nuclear Power Station, 2010.
Table C-V.3	Summary of the Ambient Dosimetry Program for Zion Nuclear Power Station, 2010.

Figures

Figure C-1	Public Water - Gross Beta – Stations Z-14 and Z-15 Collected in the Vicinity of ZNPS, 2000 - 2010.
Figure C-2	Public Water – Gross Beta – Stations Z-16 and Z-18 Collected in the Vicinity of ZNPS, 2000 - 2010.
Figure C-3	Public Water - Tritium – Stations Z-14 and Z-15 Collected in the Vicinity of ZNPS, 2000 - 2010.
Figure C-4	Public Water - Tritium – Stations Z-16 and Z-18 Collected in the Vicinity of ZNPS, 2000 - 2010.
Figure C-5	Air Particulates - Gross Beta – Stations Z-01 and Z-02 Collected in the Vicinity of ZNPS, 2000 - 2010.
Figure C-6	Air Particulate – Gross Beta – Station Z-03 Collected in the Vicinity of ZNPS, 2000 - 2010.

Appendix D Inter-Laboratory Comparison Program

Tables

Table D-1	Analytix Environmental Radioactivity Cross Check Program Teledyne Brown Engineering, 2010
Table D-2	ERA Environmental Radioactivity Cross Check Program Teledyne Brown Engineering, 2010
Table D-3	DOE's Mixed Analyte Performance Evaluation Program (MAPEP) Teledyne Brown Engineering, 2010
Table D-4	ERA Statistical Summary Proficiency Testing Program Environmental, Inc., 2010
Table D-5	DOE's Mixed Analyte Performance Evaluation Program (MAPEP) Environmental, Inc., 2010

Appendix E Effluent Data

Appendix F Meteorological Data

Appendix G Annual Radiological Groundwater Protection Program Report
(ARGPPR)

I. Summary and Conclusions

This report on the Radiological Environmental Monitoring Program conducted for the Zion Nuclear Power Station (ZNPS) by Zion *Solutions* (ZS) (Exelon was the licensee up to 08/31/2010; ZS became the licensee on 09/01/2010) covers the period 1 January 2010 through 31 December 2010. During that time period, 435 analyses were performed on 359 samples. In assessing all the data gathered for this report and comparing these results with preoperational data, it was concluded that the operation of ZNPS had no adverse radiological impact on the environment.

Public water samples were analyzed for concentrations of gross beta, tritium and gamma emitting nuclides. No fission or activation products were detected. Gross beta activities detected were consistent with those detected in previous years.

Fish (commercially and recreationally important species) and sediment samples were analyzed for concentrations of gamma emitting nuclides. No Cs-137 activity was detected in fish. No Cs-137 was detected in sediment samples. No plant produced fission or activation products were found in sediment.

Air particulate samples were analyzed for concentrations of gross beta and gamma emitting nuclides. No fission or activation products were detected.

Environmental gamma radiation measurements were performed quarterly using thermoluminescent dosimeters. Levels detected were consistent with those observed in previous years.

Intentionally left blank

II. Introduction

The Zion Nuclear Power Station (ZNPS), consisting of two 1100 MWt pressurized water reactor was owned and operated by Exelon Corporation, is located in Zion, Illinois adjacent to Lake Michigan. Unit No. 1 went critical in December 1973. Unit No. 2 went critical in September 1974. The plant permanently ceased operation in January of 1998 and has been permanently defueled. The site is located in northeast Illinois on the western shore of Lake Michigan, approximately 50 miles north of Chicago, Illinois.

This report covers those analyses performed by Teledyne Brown Engineering (TBE), Mirion Technologies, and Environmental Inc. (Midwest Labs) on samples collected during the period 1 January 2010 through 31 December 2010.

A. Objective of the REMP

The objectives of the REMP are to:

1. Provide data on measurable levels of radiation and radioactive materials in the site environs.
2. Evaluate the relationship between quantities of radioactive material released from the plant and resultant radiation doses to individuals from principal pathways of exposure.

B. Implementation of the Objectives

The implementation of the objectives is accomplished by:

1. Identifying significant exposure pathways.
2. Establishing baseline radiological data of media within those pathways.
3. Continuously monitoring those media before and during Station operation to assess Station radiological effects (if any) on man and the environment.

III. Program Description

A. Sample Collection

Samples for the ZNPS REMP were collected for ZS by Environmental Inc. (Midwest Labs). This section describes the general collection methods

used by Environmental Inc. (Midwest Labs) to obtain environmental samples for the ZNPS REMP in 2010. Sample locations and descriptions can be found in Table B-1 and Figures B-1 and B-2, Appendix B. The sampling methods used by Environmental Inc. (Midwest Labs) are listed in Table B-2.

Aquatic Environment

The aquatic environment was evaluated by performing radiological analyses on samples of public water, fish, and sediment. Two gallon water samples were collected monthly from four public water locations (Z-14, Z-15, Z-16 and Z-18). Control locations were Z-14 and Z-18. All samples were collected in new unused plastic bottles, which were rinsed at least twice with source water prior to collection. Fish samples comprising the flesh of common carp, king salmon, lake trout, longnose sucker, and rock bass were collected semiannually at two locations, Z-26 and Z-27, both Control locations. Sediment samples composed of recently deposited substrate were collected at one location semiannually, Z-25.

Atmospheric Environment

The atmospheric environment was evaluated by performing radiological analyses on samples of air particulates. Airborne particulate samples were collected and analyzed weekly at three locations (Z-01, Z-02 and Z-03). No control location was required. Airborne particulate samples were obtained at each location, using a vacuum pump with glass fiber filters attached. The pumps were run continuously and sampled air at the rate of approximately one cubic foot per minute. The filters were replaced weekly and sent to the laboratory for analysis.

Ambient Gamma Radiation

Direct radiation measurements were made using 2 CaF 200 and 2 LiF 100 LiF 4-chip Harshaw thermoluminescent dosimeters (TLD). Each location consisted of 2 TLD sets. The TLD locations were placed on and around the ZNPS site at the following locations:

Z-101, Z-102, Z-103, Z-104, Z-105, Z-106, Z-107, Z-108, Z-110, Z-111, Z-112, Z-113, Z-114, Z-115, Z-301, Z-01, Z-02 and Z-03.

No control location was required.

The specific TLD locations were determined by the following criteria:

1. The presence of relatively dense population;
2. Site meteorological data taking into account distance and elevation for each of the sixteen–22 1/2 degree sectors around the site, where estimated annual dose from ZNPS, if any, would be most significant;
3. On hills free from local obstructions and within sight of the vents (where practical);
4. And near the closest dwelling to the vents in the prevailing downwind direction.

(Two TLDs – each comprised of two CaF₂ 200 and 2 LiF 100 LiF 4-chip thermoluminescent phosphors enclosed in plastic – were placed at each location in a PVC conduit located approximately four to eight feet above ground level. The TLDs were exchanged quarterly and sent to Mirion Technologies for analysis.

B. Sample Analysis

This section describes the general analytical methodologies used by TBE and Environmental Inc. (Midwest Labs) to analyze the environmental samples for radioactivity for the ZNPS REMP in 2010. The analytical procedures used by the laboratories are listed in Table B-2.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of beta emitters in public water and air particulates.
2. Concentrations of gamma emitters in public water, air particulates, fish and sediment.
3. Concentrations of tritium in public water.
4. Ambient gamma radiation levels at various site environs.

C. Data Interpretation

The radiological and direct radiation data collected prior to Zion Nuclear Power Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, Zion Nuclear Power Station was considered operational at initial criticality. In addition, data were compared to previous years' operational data for

consistency and trending. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) was defined as the smallest concentration of radioactive material in a sample that would yield a net count (above background) that would be detected with only a 5% probability of falsely concluding that a blank observation represents a "real" signal. The LLD was intended as a before the fact estimate of a system (including instrumentation, procedure and sample type) and not as an after the fact criteria for the presence of activity. All analyses were designed to achieve the required ZNPS detection capabilities for environmental sample analysis.

The minimum detectable concentration (MDC) is defined above with the exception that the measurement is an after the fact estimate of the presence of activity.

2. Net Activity Calculation and Reporting of Results

Net activity for a sample was calculated by subtracting background activity from the sample activity. Since the REMP measures extremely small changes in radioactivity in the environment, background variations may result in sample activity being lower than the background activity effecting a negative number. An MDC was reported in all cases where positive activity was not detected.

Gamma spectroscopy results for each type of sample were grouped as follows:

For public water, sediment and air particulates 11 nuclides, Mn-54, Co-58, Fe-59, Co-60, Zn-65, Nb-95, Zr-95, Cs-134, Cs-137, Ba-140 and La-140 were reported.

Means and standard deviations of the results were calculated. The standard deviations represent the variability of measured results for different samples rather than single analysis uncertainty.

D. Program Exceptions

For 2010 the ZNPS REMP had a sample recovery rate in excess of 99%. Sample anomalies and missed samples are listed in the tables below:

Table D-1 LISTING OF SAMPLE ANOMALIES

Sample Type	Location Code	Collection Date	Reason
-------------	---------------	-----------------	--------

There were no sample anomalies in 2010.

Table D-2 LISTING OF MISSED SAMPLES

Sample Type	Location Code	Collection Date	Reason
-------------	---------------	-----------------	--------

There were no missed samples for 2010.

Each program exception was reviewed to understand the causes of the program exception. Sampling and maintenance errors were reviewed with the personnel involved to prevent recurrence. Occasional equipment breakdowns and power outages were unavoidable.

The overall sample recovery rate indicates that the appropriate procedures and equipment are in place to assure reliable program implementation.

E. Program Changes

There were no changes to the REMP program in 2010.

IV. Results and Discussion

A. Aquatic Environment

1. Public Water

Samples were taken weekly and composited monthly at four locations (Z-14, Z-15, Z-16 and Z-18). The following analyses were performed.

Gross Beta

Samples from all locations were analyzed for concentrations of gross beta (Table C-1.1, Appendix C). The values ranged from 2.4 pCi/l to 4.7 pCi/l. Concentrations detected were consistent with those detected in previous years (Figures C-1 and C-2, Appendix C).

Tritium

Quarterly composites of weekly collections were analyzed for tritium activity (Table C–I.2, Appendix C). No tritium was detected and the LLD was met (Figures C–3 and C–4, Appendix C).

Gamma Spectrometry

Samples from both locations were analyzed for gamma emitting nuclides (Table C–I.3, Appendix C). No nuclides were detected and all required LLDs were met.

2. Fish

Fish samples comprised of common carp, king salmon, lake trout, longnose sucker, and rock bass were collected at two locations (Z-26 and Z-27) semiannually. The following analysis was performed:

Gamma Spectrometry

The edible portion of fish samples from both locations was analyzed for gamma emitting nuclides (Table C–II.1, Appendix C). No nuclides were detected and all required LLDs were met.

3. Sediment

Aquatic sediment samples were collected at one location (Z-25) semiannually. The following analysis was performed:

Gamma Spectrometry

Sediment samples from Z-25 were analyzed for gamma emitting nuclides (Table C–III.1, Appendix C). No nuclides were detected and all required LLDs were met.

B. Atmospheric Environment

1. Airborne

a. Air Particulates

Continuous air particulate samples were collected from three locations on a weekly basis. The three locations were within the ZNPS site boundary (Z-01, Z-02 and Z-03). The following analyses were performed:

Gross Beta

Weekly samples were analyzed for concentrations of beta emitters (Table C–IV.1 and C–IV.2, Appendix C).

Detectable gross beta activity was observed at all locations. Comparison of results among the three groups aid in determining the effects, if any, resulting from the operation of ZNPS. The results from the On-Site locations ranged from 7 E-3 pCi/m³ to 43 E–3 pCi/m³ with a mean of 17 E–3 pCi/m³. Comparison of the 2010 air particulate data with previous years data indicate no effects from the operation of ZNPS. Concentrations detected were consistent with those detected in previous years.

Gamma Spectrometry

Weekly samples were composited quarterly and analyzed for gamma emitting nuclides (Table C–IV.3, Appendix C). No nuclides were detected and all required LLDs were met.

C. Ambient Gamma Radiation

Ambient gamma radiation levels were measured utilizing Harshaw (CaF and LiF) thermoluminescent dosimeters. Thirty-six TLD locations were established around the site. Results of TLD measurements are listed in Tables C–V.1 to C–V.3, Appendix C.

Most TLD measurements were below 25 mR/quarter, with a range of 15 mR/quarter to 27 mR/quarter.

D. Land Use Survey

A Land Use Survey conducted during August 2010 around the Zion Nuclear Power Station (ZNPS) was performed by Environmental Inc. (Midwest Labs) for ZS to comply with Chapter 3 of the Zion' Offsite Dose Calculation Manual. The purpose of the survey was to document the nearest resident, milk producing animal and garden of greater than 500 ft² in each of the sixteen 22 ½ degree sectors around the site. There were no changes required to the ZNPS REMP, as a result of this survey. The results of this survey are summarized below.

Distance in Miles from the ZNPS Reactor Buildings			
Sector	Residence Miles	Livestock Miles	Milk Farm Miles
A N	2.5	-	-
B NNE	-	-	-
C NE	-	-	-
D ENE	-	-	-
E E	-	-	-
F ESE	-	-	-
G SE	-	-	-
H SSE	-	-	-
J S	-	-	-
K SSW	1.9	-	-
L SW	1.1	-	-
M WSW	1.0	-	-
N W	1.1	-	-
P WNW	1.0	-	-
Q NW	1.0	-	-
R NNW	1.3	-	-

E. Summary of Results – Inter-Laboratory Comparison Program

The primary and secondary laboratories analyzed Performance Evaluation (PE) samples of air particulate, air iodine, milk, soil, vegetation and water matrices for (Appendix D). The PE samples, supplied by Analytics Inc., Environmental Resource Associates (ERA) and DOE's Mixed Analyte Performance Evaluation Program (MAPEP), were evaluated against the following pre-set acceptance criteria:

1. Analytics Evaluation Criteria

Analytics' evaluation report provides a ratio of laboratory results and Analytics' known value. Since flag values are not assigned by Analytics, TBE-ES evaluates the reported ratios based on internal QC requirements, which are based on the DOE MAPEP criteria.

2. ERA Evaluation Criteria

ERA's evaluation report provides an acceptance range for control and warning limits with associated flag values. ERA's acceptance limits are established per the USEPA, NELAC, state specific PT program requirements or ERA's SOP for the Generation of Performance Acceptance Limits, as applicable. The acceptance limits are either determined by a regression equation specific to each analyte or a fixed percentage limit promulgated under the appropriate regulatory document.

3. DOE Evaluation Criteria

MAPEP's evaluation report provides an acceptance range with associated flag values.

The MAPEP defines three levels of performance: Acceptable (flag = "A"), Acceptable with Warning (flag = "W"), and Not Acceptable (flag = "N"). Performance is considered acceptable when a mean result for the specified analyte is $\pm 20\%$ of the reference value. Performance is acceptable with warning when a mean result falls in the range from $\pm 20\%$ to $\pm 30\%$ of the reference value (i.e., $20\% < \text{bias} < 30\%$). If the bias is greater than 30%, the results are deemed not acceptable.

For the primary laboratory, 16 out of 18 analytes met the specified acceptance criteria. Two analytes did not meet the specified acceptance criteria for the following reason:

1. Teledyne Brown Engineering's ERA November 2010 Sr-89 in water result of 77.8 pCi/L was higher than the known value of 68.5 pCi/L, resulting in a found to known ratio of 1.14. NCR 10-09 was initiated to investigate this failure. Since the ratio of 1.14 fell within an acceptance range of 20%, Teledyne considers this an acceptable result.
2. Teledyne Brown Engineering's ERA November 2010 Zn-65 in water result of 11.0 pCi/L was lower than the known value of 102 pCi/L. NCR 10-09 was initiated to investigate this failure. The Zn-65 result of 111 was incorrectly reported as 11.0.

For the secondary laboratory, Environmental, Inc., 14 out of 14 analytes met the specified acceptance criteria.

The Inter-Laboratory Comparison Program provides evidence of "in control" counting systems and methods, and that the laboratories are producing accurate and reliable data.

Intentionally left blank

APPENDIX A

RADIOLOGICAL ENVIRONMENTAL MONITORING REPORT SUMMARY

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE ZION NUCLEAR POWER STATION, 2010**

Name of Facility: ZION		DOCKET NUMBER: 50-295 & 50-304									
Location of Facility: ZION IL		REPORTING PERIOD: ANNUAL 2010					LOCATION WITH HIGHEST ANNUAL MEAN (M)				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	LOCATIONS		CONTROL		STATION #		NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	NAME	DISTANCE AND DIRECTION		
PUBLIC WATER (PCI/LITER)	GR-B	48	4	3.4 (16/24) (2.5/4.7)	3.3 (19/24) (2.4/4.7)	3.5 (7/12) (2.8/4.7)	Z-15 INDICATOR	LAKE COUNTY WATER WORKS 1.4 MILES NNW OF SITE	0		
	H-3	16	200	<LLD	<LLD	-			0		
	GAMMA MN-54	48	15	<LLD	<LLD	-			0		
	CO-58		15	<LLD	<LLD	-			0		
	FE-59		30	<LLD	<LLD	-			0		
	CO-60		15	<LLD	<LLD	-			0		
	ZN-65		30	<LLD	<LLD	-			0		
	NB-95		15	<LLD	<LLD	-			0		

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING BOTH THE MDAs AND THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE ZION NUCLEAR POWER STATION, 2010**

Name of Facility: ZION		DOCKET NUMBER: 50-295 & 50-304									
Location of Facility: ZION IL		REPORTING PERIOD: ANNUAL 2010		LOCATION WITH HIGHEST ANNUAL MEAN (M)							
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	LOCATIONS		CONTROL		STATION #		NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	NAME	DISTANCE AND DIRECTION		
PUBLIC WATER (PCI/LITER)	ZR-95		15	<LLD	<LLD	<LLD	-			0	
	CS-134		15	<LLD	<LLD	<LLD	-			0	
	CS-137		18	<LLD	<LLD	<LLD	-			0	
	BA-140		NA	<LLD	<LLD	<LLD	-			0	
	LA-140		NA	<LLD	<LLD	<LLD	-			0	
FISH (PCI/KG WET)	GAMMA MN-54	9	130	<LLD	NA	NA	-			0	
	CO-58		130	<LLD	NA	NA	-			0	
	FE-59		260	<LLD	NA	NA	-			0	

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING BOTH THE MDAs AND THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE ZION NUCLEAR POWER STATION, 2010**

Name of Facility: ZION		DOCKET NUMBER: 50-295 & 50-304									
Location of Facility: ZION IL		REPORTING PERIOD: ANNUAL 2010					LOCATION WITH HIGHEST ANNUAL MEAN (M)				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	LOCATIONS		CONTROL		STATION #		NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	NAME	DISTANCE AND DIRECTION		
FISH (PCI/KG WET)	CO-60		130	<LLD	NA	-				0	
	ZN-65		260	<LLD	NA	-				0	
	NB-95		NA	<LLD	NA	-				0	
	ZR-95		NA	<LLD	NA	-				0	
	CS-134		100	<LLD	NA	-				0	
	CS-137		100	<LLD	NA	-				0	
	BA-140		NA	<LLD	NA	-				0	
	LA-140		NA	<LLD	NA	-				0	

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING BOTH THE MDAs AND THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE ZION NUCLEAR POWER STATION, 2010**

Name of Facility: ZION		DOCKET NUMBER: 50-295 & 50-304									
Location of Facility: ZION IL		REPORTING PERIOD: ANNUAL 2010		LOCATION WITH HIGHEST ANNUAL MEAN (M)							
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	INDICATOR CONTROL		CONTROL		LOCATION		STATION # NAME	NUMBER OF NONROUTINE REPORTED MEASUREMENTS
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE		
SEDIMENT (PCI/KG DRY)	GAMMA MN-54	2	NA	<LLD	NA	-	NA	-	NA	-	0
	CO-58		NA	<LLD	NA	-	NA	-	NA	-	0
	FE-59		NA	<LLD	NA	-	NA	-	NA	-	0
	CO-60		NA	<LLD	NA	-	NA	-	NA	-	0
	ZN-65		NA	<LLD	NA	-	NA	-	NA	-	0
	NB-95		NA	<LLD	NA	-	NA	-	NA	-	0
	ZR-95		NA	<LLD	NA	-	NA	-	NA	-	0
	CS-134		150	<LLD	NA	-	NA	-	NA	-	0

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING BOTH THE MDAs AND THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE ZION NUCLEAR POWER STATION, 2010**

Name of Facility: ZION		DOCKET NUMBER: 50-295 & 50-304									
Location of Facility: ZION IL		REPORTING PERIOD: ANNUAL 2010					LOCATION WITH HIGHEST ANNUAL MEAN (M)				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	LOCATIONS		CONTROL		STATION #		NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	NAME	DISTANCE AND DIRECTION		
SEDIMENT (PCI/KG DRY)	CS-137	180	180	<LLD	NA	NA	-	-	-	0	
	BA-140	NA	NA	<LLD	NA	NA	-	-	-	0	
	LA-140	NA	NA	<LLD	NA	NA	-	-	-	0	
AIR PARTICULATE (E-3 PCI/CU.METER)	GR-B	156	10	17 (156/156) (7/43)	NA	NA	17 (52/52) (8/43)	Z-03 INDICATOR ONSITE 3 0.2 MILES NNW OF SITE		0	
	GAMMA MN-54	12	NA	<LLD	NA	NA	-	-	-	0	
	CO-58		NA	<LLD	NA	NA	-	-	-	0	
	FE-59		NA	<LLD	NA	NA	-	-	-	0	
	CO-60		NA	<LLD	NA	NA	-	-	-	0	

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING BOTH THE MDAs AND THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

**TABLE A-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANNUAL SUMMARY FOR
THE ZION NUCLEAR POWER STATION, 2010**

Name of Facility: ZION		DOCKET NUMBER: 50-295 & 50-304									
Location of Facility: ZION IL		REPORTING PERIOD: ANNUAL 2010					LOCATION WITH HIGHEST ANNUAL MEAN (M)				
MEDIUM OR PATHWAY SAMPLED (UNIT OF MEASUREMENT)	TYPES OF ANALYSIS PERFORMED	NUMBER OF ANALYSIS PERFORMED	REQUIRED LOWER LIMIT OF DETECTION (LLD)	LOCATIONS		CONTROL		STATION #		NUMBER OF NONROUTINE REPORTED MEASUREMENTS	
				MEAN (M) (F)	RANGE	MEAN (M) (F)	RANGE	NAME	DISTANCE AND DIRECTION		
AIR PARTICULATE (E-3 PCI/CU.METER)	ZN-65	NA	NA	<LLD	NA	-	0			0	
	NB-95	NA	NA	<LLD	NA	-	0			0	
	ZR-95	NA	NA	<LLD	NA	-	0			0	
	CS-134	10	10	<LLD	NA	-	0			0	
	CS-137	10	10	<LLD	NA	-	0			0	
	BA-140	NA	NA	<LLD	NA	-	0			0	
	LA-140	NA	NA	<LLD	NA	-	0			0	
DIRECT RADIATION (MILLI-ROENTGEN/QTR.)	TLD-QUARTERLY	144	NA	20.2 (144/144) (15/27)	NA	23.0 (4/4) (20/27)	0	Z-301-2 INDICATOR 0.5 MILES NW		0	

* THE MEAN AND 2 STANDARD DEVIATION VALUES ARE CALCULATED USING BOTH THE MDAs AND THE POSITIVE VALUES FRACTION OF DETECTABLE MEASUREMENTS AT SPECIFIED LOCATIONS IS INDICATED IN PARENTHESES (F)

APPENDIX B

LOCATION DESIGNATION, DISTANCE & DIRECTION, AND SAMPLE COLLECTION & ANALYTICAL METHODS

TABLE B-1: Radiological Environmental Monitoring Program - Sampling Locations, Distance and Direction, Zion Nuclear Power Station, 2010

Location	Location Description	Distance & Direction From Site
<u>A. Public Water</u>		
Z-14	Kenosha Water Works (control)	10.0 miles N
Z-15	Lake County Water Works (indicator)	1.4 miles NNW
Z-16	Waukegan Water Works (indicator)	6.1 miles S
Z-18	Lake Forest Water Works (control)	12.9 miles S
<u>B. Air Particulates</u>		
Z-01	Onsite 1 (indicator)	0.3 miles S
Z-02	Onsite 2 (indicator)	0.2 miles W
Z-03	Onsite 3 (indicator)	0.2 miles NNW
<u>C. Fish</u>		
Z-26	Lake Michigan Nearsite (indicator)	At station
Z-27	Lake Michigan Farsite (indicator)	10.1 miles N
<u>D. Sediment</u>		
Z-25	Lake Michigan, Illinois Beach State Park (indicator)	0.2 miles S
<u>E. Environmental Dosimetry - TLD</u>		
<u>Inner Ring</u>		
Z-101-1 and -2		0.2 miles N
Z-102-1 and -2		0.2 miles NNE
Z-103-1 and -2		0.2 miles NE
Z-104-1 and -2		0.1 miles ENE
Z-105-1 and -2		0.1 miles E
Z-106-1 and -2		0.1 miles ESE
Z-107-1 and -2		0.1 miles SE
Z-108-1 and -2		0.1 miles SSE
Z-110-1 and -2		0.2 miles SSW
Z-111-1 and -2		0.3 miles SW
Z-112-1 and -2		0.7 miles WSW
Z-113-1 and -2		0.6 miles W
Z-114-1 and -2		0.6 miles WNW
Z-115-1 and -2		0.4 miles NW
Z-301-1 and -2		0.5 miles NW
<u>Other</u>		
Z-01-1 and -2	Onsite 1 (indicator)	0.3 miles S
Z-02-1 and -2	Onsite 2 (indicator)	0.2 miles W
Z-03-1 and -2	Onsite 3 (indicator)	0.2 miles NNW

TABLE B-2: Radiological Environmental Monitoring Program – Summary of Sample Collection and Analytical Methods, Zion Nuclear Power Station, 2010

Sample Medium	Analysis	Sampling Method	Analytical Procedure Number
Public Water	Gamma Spectroscopy	Monthly composite from weekly grab samples.	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., GS-01 Determination of gamma emitters by gamma spectroscopy
Public Water	Gross Beta	Monthly composite from weekly grab samples.	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices Env. Inc., W(DS)-01 Determination of gross alpha and/or gross beta in water (dissolved solids or total residue)
Public Water	Tritium	Quarterly composite from weekly grab samples.	TBE, TBE-2011 Tritium analysis in drinking water by liquid scintillation Env. Inc., T-02 Determination of tritium in water (direct method)
Fish	Gamma Spectroscopy	Semi-annual samples collected via electroshocking or other techniques	TBE-2007 Gamma emitting radioisotope analysis Env. Inc., GS-01 Determination of gamma emitters by gamma spectroscopy
Sediment	Gamma Spectroscopy	Semi-annual grab samples	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., GS-01 Determination of gamma emitters by gamma spectroscopy
Air Particulates	Gross Beta	One-week composite of continuous air sampling through glass fiber filter paper	TBE, TBE-2008 Gross Alpha and/or gross beta activity in various matrices Env. Inc., AP-02 Determination of gross alpha and/or gross beta in air particulate filters
Air Particulates	Gamma Spectroscopy	Quarterly composite of each station	TBE, TBE-2007 Gamma emitting radioisotope analysis Env. Inc., GS-01 Determination of gamma emitters by gamma spectroscopy
TLD	Thermoluminescence Dosimetry	Quarterly TLDs comprised of two CaF 200 and two LiF 100 LiF 4-chip Harshaw elements.	Mirion Technologies


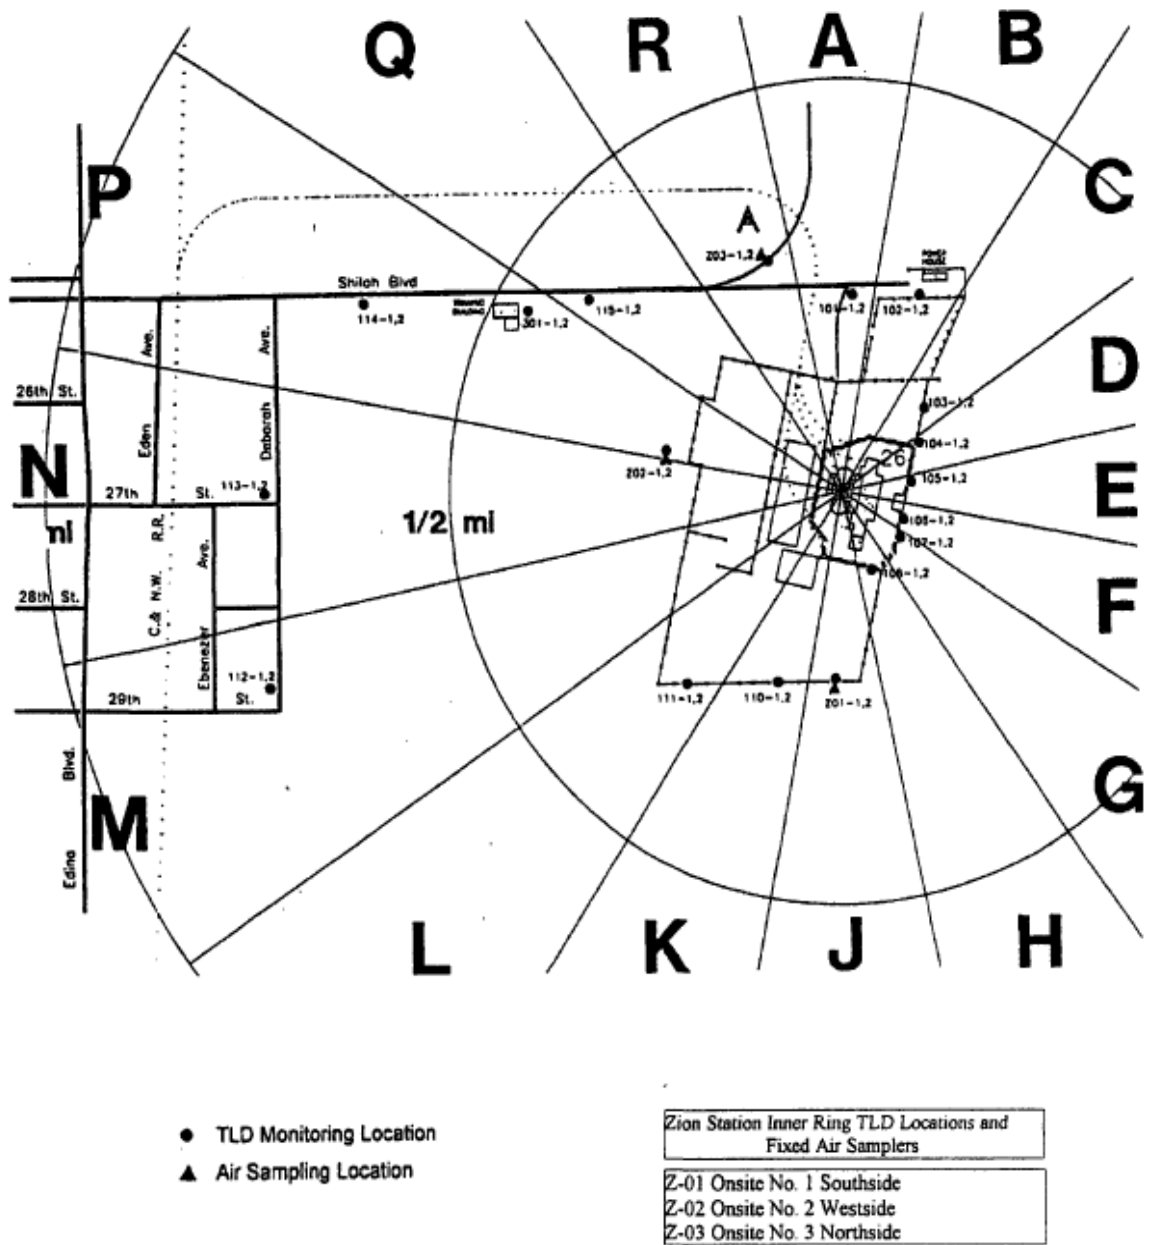


Figure B-1
 Inner Ring TLD Locations and Fixed Air Samplers of the Zion Nuclear Power Station, 2010
 B-3

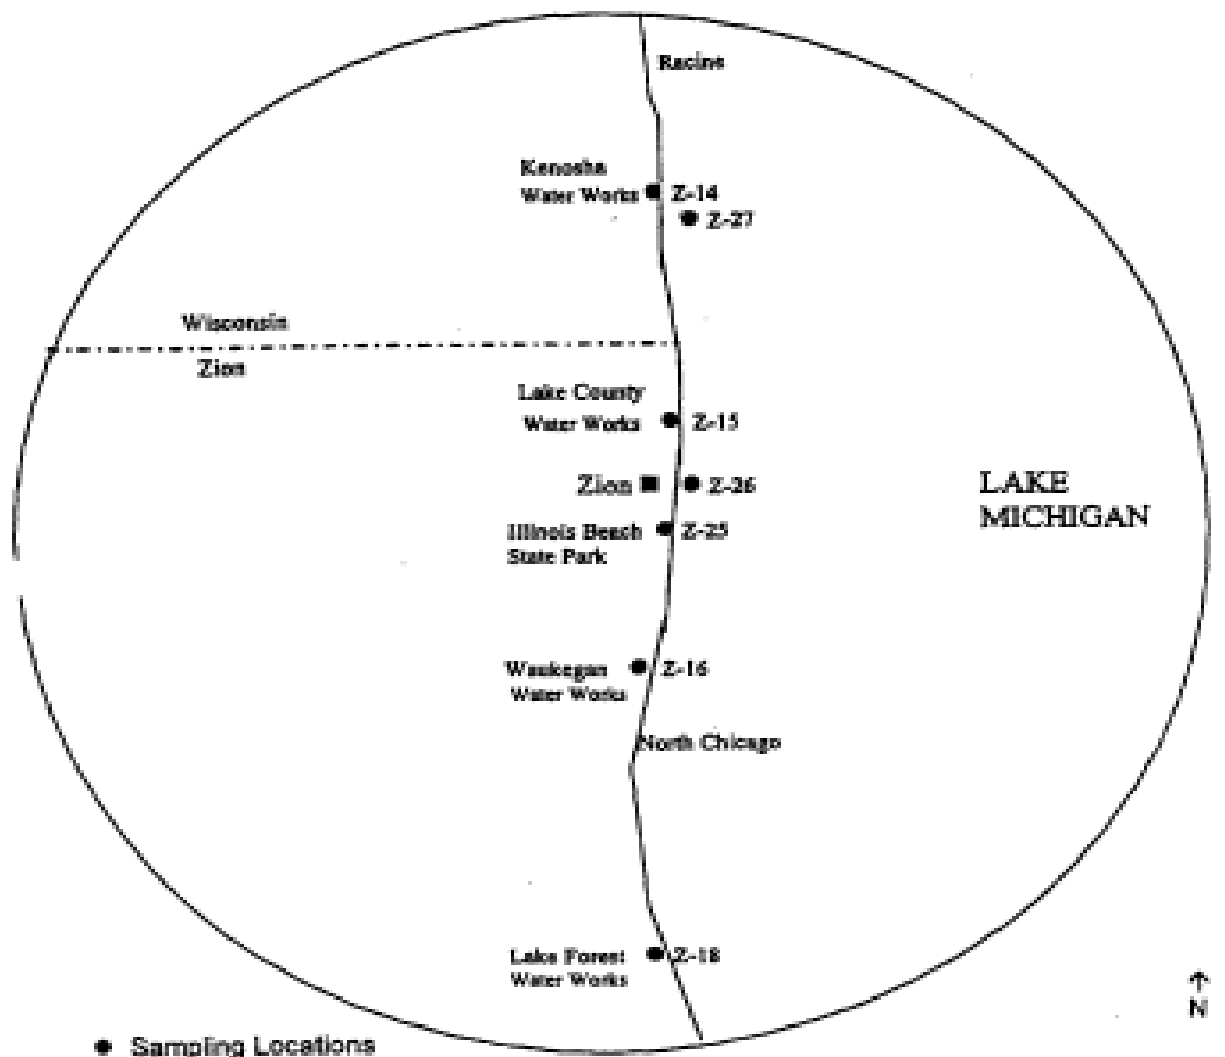

Fish, Water and Sediment Locations
Z-14 Kenosha Water Works
Z-15 Lake County Water Works
Z-16 Waukegan Water Works
Z-18 Lake Forest Water Works
Z-25 Illinois Beach State Park
Z-26 Lake Michigan at Discharge
Z-27 Lake Michigan 10 mi. North (C)

Figure B-2
 Fish, Water and Sediment Locations of the Zion Nuclear Power Station, 2010
 B-4

APPENDIX C

DATA TABLES PRIMARY LABORATORY

TABLE C-I.1**CONCENTRATIONS OF GROSS BETA IN PUBLIC WATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010**RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	Z-14	Z-15	Z-16	Z-18
01/06/10 - 01/27/10	4.0 \pm 1.8	4.7 \pm 1.9	2.7 \pm 1.7	2.9 \pm 1.7
02/03/10 - 02/24/10	2.6 \pm 1.7	3.9 \pm 1.9	4.4 \pm 1.9	< 2.5
03/03/10 - 03/31/10	< 2.8	< 2.8	< 2.8	2.9 \pm 1.9
04/07/10 - 04/28/10	3.8 \pm 1.7	4.0 \pm 1.7	4.2 \pm 1.7	3.9 \pm 1.7
05/05/10 - 05/25/10	3.7 \pm 1.8	< 2.5	< 2.5	4.7 \pm 1.9
06/02/10 - 06/30/10	< 2.2	3.0 \pm 1.6	2.5 \pm 1.5	2.4 \pm 1.6
07/07/10 - 07/28/10	2.8 \pm 1.7	< 2.5	< 2.5	3.6 \pm 1.8
08/04/10 - 08/31/10	< 2.5	< 2.5	3.9 \pm 1.8	3.4 \pm 1.7
09/08/10 - 09/29/10	2.6 \pm 1.5	2.8 \pm 1.5	2.5 \pm 1.5	3.6 \pm 1.6
10/07/10 - 10/27/10	3.2 \pm 1.5	3.1 \pm 1.5	2.8 \pm 1.5	3.2 \pm 1.6
11/04/10 - 11/24/10	< 3.2	< 3.2	3.8 \pm 2.2	3.8 \pm 2.2
12/01/10 - 12/29/10	3.0 \pm 1.5	2.8 \pm 1.5	3.3 \pm 1.3	3.1 \pm 1.6
MEAN	3.2 \pm 1.1	3.5 \pm 1.5	3.4 \pm 1.5	3.4 \pm 1.2

TABLE C-I.2**CONCENTRATIONS OF TRITIUM IN PUBLIC WATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010**RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

COLLECTION PERIOD	Z-14	Z-15	Z-16	Z-18
01/06/10 - 03/31/10	< 170	< 170	< 168	< 170
04/07/10 - 06/30/10	< 161	< 158	< 160	< 158
07/07/10 - 09/29/10	< 170	< 166	< 166	< 169
10/07/10 - 12/29/10	< 165	< 168	< 170	< 170
MEAN	-	-	-	-

* THE MEAN AND 2 STANDARD DEVIATION ARE CALCULATED USING THE POSITIVE VALUES

TABLE C-1.3
CONCENTRATIONS OF GAMMA EMITTERS IN PUBLIC WATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

STC	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
Z-14	01/06/10 - 01/27/10	< 4	< 6	< 9	< 4	< 11	< 6	< 8	< 5	< 6	< 35	< 10
	02/03/10 - 02/24/10	< 3	< 3	< 7	< 3	< 6	< 3	< 6	< 3	< 3	< 25	< 8
	03/03/10 - 03/31/10	< 1	< 1	< 2	< 1	< 1	< 1	< 1	< 0	< 1	< 16	< 6
	04/07/10 - 04/28/10	< 5	< 7	< 17	< 5	< 10	< 6	< 11	< 4	< 5	< 66	< 24
	05/05/10 - 05/25/10	< 4	< 4	< 10	< 3	< 8	< 5	< 7	< 3	< 4	< 47	< 15
	06/02/10 - 06/30/10	< 4	< 5	< 11	< 4	< 9	< 6	< 8	< 4	< 5	< 44	< 12
	07/07/10 - 07/28/10	< 3	< 3	< 9	< 3	< 6	< 4	< 6	< 3	< 3	< 29	< 11
	08/04/10 - 08/31/10	< 5	< 7	< 22	< 7	< 14	< 7	< 14	< 6	< 6	< 86	< 24
	09/08/10 - 09/29/10	< 3	< 5	< 15	< 2	< 5	< 6	< 9	< 2	< 2	< 1040	< 309
	10/07/10 - 10/27/10	< 5	< 7	< 25	< 5	< 10	< 10	< 14	< 5	< 5	< 517	< 158
	11/04/10 - 11/24/10	< 4	< 5	< 16	< 3	< 9	< 7	< 12	< 4	< 4	< 118	< 42
	12/01/10 - 12/29/10	< 5	< 6	< 15	< 4	< 9	< 6	< 11	< 6	< 6	< 51	< 14
MEAN		-	-	-	-	-	-	-	-	-	-	-
Z-15	01/06/10 - 01/27/10	< 9	< 6	< 17	< 6	< 13	< 8	< 15	< 6	< 8	< 56	< 19
	02/03/10 - 02/24/10	< 3	< 3	< 7	< 3	< 7	< 4	< 6	< 3	< 4	< 28	< 9
	03/03/10 - 03/31/10	< 1	< 1	< 3	< 1	< 2	< 1	< 2	< 1	< 1	< 23	< 7
	04/07/10 - 04/28/10	< 5	< 6	< 14	< 5	< 10	< 6	< 11	< 4	< 5	< 64	< 23
	05/05/10 - 05/25/10	< 4	< 5	< 12	< 4	< 8	< 5	< 9	< 5	< 5	< 67	< 18
	06/02/10 - 06/30/10	< 4	< 6	< 13	< 5	< 11	< 7	< 9	< 5	< 5	< 48	< 16
	07/07/10 - 07/28/10	< 6	< 7	< 13	< 6	< 14	< 6	< 15	< 5	< 7	< 63	< 21
	08/04/10 - 08/31/10	< 5	< 7	< 13	< 6	< 10	< 6	< 8	< 4	< 6	< 81	< 21
	09/08/10 - 09/29/10	< 3	< 6	< 21	< 3	< 7	< 7	< 12	< 3	< 3	< 1190	< 412
	10/07/10 - 10/27/10	< 4	< 8	< 23	< 4	< 11	< 9	< 13	< 5	< 4	< 413	< 127
	11/04/10 - 11/24/10	< 6	< 7	< 17	< 4	< 12	< 8	< 12	< 5	< 5	< 171	< 45
	12/01/10 - 12/29/10	< 5	< 6	< 11	< 5	< 10	< 5	< 10	< 5	< 4	< 51	< 18
MEAN		-	-	-	-	-	-	-	-	-	-	-

TABLE C-1.3

**CONCENTRATIONS OF GAMMA EMITTERS IN PUBLIC WATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010**

RESULTS IN UNITS OF PCI/LITER ± 2 SIGMA

STC	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
Z-16	01/06/10 - 01/27/10	< 7	< 7	< 16	< 5	< 11	< 8	< 16	< 7	< 9	< 47	< 18
	02/03/10 - 02/24/10	< 2	< 2	< 4	< 2	< 4	< 2	< 4	< 2	< 2	< 15	< 5
	03/03/10 - 03/31/10	< 1	< 1	< 4	< 1	< 2	< 2	< 3	< 1	< 1	< 33	< 11
	04/07/10 - 04/28/10	< 6	< 7	< 16	< 6	< 11	< 7	< 13	< 7	< 6	< 88	< 24
	05/05/10 - 05/25/10	< 3	< 4	< 9	< 3	< 6	< 4	< 6	< 3	< 3	< 42	< 14
	06/02/10 - 06/30/10	< 7	< 8	< 18	< 6	< 15	< 7	< 14	< 8	< 7	< 73	< 21
	07/07/10 - 07/28/10	< 6	< 7	< 17	< 5	< 13	< 7	< 10	< 6	< 6	< 57	< 16
	08/04/10 - 08/31/10	< 5	< 7	< 11	< 6	< 11	< 7	< 13	< 5	< 5	< 74	< 29
	09/08/10 - 09/29/10	< 3	< 6	< 18	< 2	< 6	< 6	< 11	< 3	< 3	< 1230	< 409
	10/07/10 - 10/27/10	< 5	< 8	< 20	< 4	< 9	< 9	< 13	< 4	< 4	< 469	< 142
	11/04/10 - 11/24/10	< 6	< 8	< 17	< 6	< 10	< 9	< 13	< 6	< 7	< 186	< 52
	12/01/10 - 12/29/10	< 5	< 6	< 14	< 5	< 11	< 6	< 11	< 5	< 6	< 58	< 15
	MEAN	-	-	-	-	-	-	-	-	-	-	-
Z-18	01/06/10 - 01/27/10	< 8	< 9	< 15	< 7	< 15	< 6	< 13	< 5	< 7	< 42	< 17
	02/03/10 - 02/24/10	< 2	< 2	< 5	< 2	< 4	< 2	< 4	< 2	< 2	< 17	< 5
	03/03/10 - 03/31/10	< 4	< 6	< 16	< 5	< 8	< 7	< 11	< 4	< 5	< 148	< 41
	04/07/10 - 04/28/10	< 6	< 6	< 18	< 8	< 10	< 8	< 12	< 5	< 5	< 90	< 29
	05/05/10 - 05/25/10	< 3	< 4	< 9	< 4	< 7	< 4	< 7	< 3	< 3	< 46	< 15
	06/02/10 - 06/30/10	< 4	< 7	< 13	< 6	< 12	< 7	< 12	< 5	< 5	< 50	< 14
	07/07/10 - 07/28/10	< 7	< 7	< 17	< 6	< 11	< 9	< 12	< 6	< 7	< 65	< 24
	08/04/10 - 08/31/10	< 6	< 4	< 14	< 5	< 9	< 6	< 11	< 5	< 5	< 74	< 25
	09/08/10 - 09/29/10	< 3	< 5	< 17	< 3	< 7	< 7	< 12	< 3	< 2	< 1200	< 353
	10/07/10 - 10/27/10	< 4	< 7	< 18	< 4	< 10	< 8	< 13	< 4	< 4	< 412	< 99
	11/04/10 - 11/24/10	< 5	< 8	< 16	< 4	< 11	< 8	< 13	< 5	< 5	< 153	< 55
	12/01/10 - 12/29/10	< 5	< 6	< 10	< 6	< 11	< 7	< 9	< 5	< 5	< 62	< 17
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-II.1

CONCENTRATIONS OF GAMMA EMITTERS IN FISH SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF PCI/KG WET ± 2 SIGMA

STC	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
Z-26												
Lake Trout	05/05/10	< 64	< 84	< 215	< 96	< 138	< 78	< 182	< 68	< 93	< 930	< 290
Lake Trout	05/25/10	< 85	< 101	< 254	< 75	< 176	< 118	< 183	< 77	< 90	< 1980	< 632
Rock Bass	10/07/10	< 82	< 130	< 461	< 59	< 153	< 133	< 256	< 64	< 60	< 26400	< 8510
Common Carp	10/19/10	< 62	< 98	< 277	< 69	< 120	< 111	< 208	< 49	< 55	< 12400	< 3790
King Salmon	10/19/10	< 57	< 85	< 264	< 50	< 109	< 112	< 104	< 42	< 57	< 9640	< 2900
	MEAN	-	-	-	-	-	-	-	-	-	-	-
Z-27												
Lake Trout	05/13/10	< 60	< 85	< 188	< 56	< 150	< 89	< 142	< 68	< 68	< 2010	< 490
Common Carp	05/26/10	< 31	< 31	< 77	< 31	< 62	< 29	< 62	< 28	< 28	< 356	< 159
Lake Trout	10/19/10	< 60	< 84	< 319	< 60	< 103	< 118	< 184	< 52	< 63	< 11000	< 3610
Longnose Sucker	10/19/10	< 50	< 77	< 226	< 52	< 128	< 115	< 170	< 47	< 49	< 8710	< 3420
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-III.1 CONCENTRATIONS OF GAMMA EMITTERS IN SEDIMENT SAMPLES COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF PCI/KG DRY ± 2 SIGMA

STC	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
Z-25	05/19/10	< 44	< 47	< 138	< 39	< 116	< 66	< 105	< 53	< 41	< 910	< 212
	10/07/10	< 55	< 115	< 298	< 63	< 123	< 131	< 166	< 42	< 49	< 17500	< 6420
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-IV.1 CONCENTRATIONS OF GROSS BETA IN AIR PARTICULATE SAMPLES COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF E-3 PCI/CU METER \pm 2 SIGMA

COLLECTION PERIOD	GROUP I		
	Z-01	Z-02	Z-03
12/30/09 - 01/06/10	27 \pm 7	23 \pm 4	21 \pm 4
01/06/10 - 01/13/10	22 \pm 5	20 \pm 4	21 \pm 5
01/13/10 - 01/20/10	36 \pm 5	38 \pm 5	43 \pm 6
01/20/10 - 01/27/10	17 \pm 4	21 \pm 4	22 \pm 4
01/27/10 - 02/03/10	20 \pm 4	19 \pm 4	18 \pm 4
02/03/10 - 02/11/10	18 \pm 4	18 \pm 4	16 \pm 4
02/11/10 - 02/17/10	10 \pm 4	13 \pm 4	9 \pm 4
02/17/10 - 02/24/10	15 \pm 4	16 \pm 4	13 \pm 4
02/24/10 - 03/03/10	15 \pm 3	13 \pm 3	17 \pm 3
03/03/10 - 03/10/10	16 \pm 5	17 \pm 5	16 \pm 4
03/10/10 - 03/17/10	15 \pm 4	11 \pm 4	12 \pm 4
03/17/10 - 03/24/10	16 \pm 5	17 \pm 5	17 \pm 5
03/24/10 - 03/31/10	14 \pm 6	12 \pm 5	15 \pm 5
03/31/10 - 04/07/10	14 \pm 4	15 \pm 4	13 \pm 4
04/07/10 - 04/14/10	7 \pm 4	13 \pm 4	12 \pm 4
04/14/10 - 04/21/10	12 \pm 4	9 \pm 4	8 \pm 4
04/21/10 - 04/28/10	11 \pm 4	13 \pm 4	16 \pm 4
04/28/10 - 05/05/10	13 \pm 4	14 \pm 4	12 \pm 4
05/05/10 - 05/12/10	9 \pm 3	10 \pm 3	9 \pm 3
05/12/10 - 05/19/10	13 \pm 4	8 \pm 3	10 \pm 3
05/19/10 - 05/25/10	10 \pm 4	17 \pm 4	16 \pm 4
05/25/10 - 06/02/10	15 \pm 3	13 \pm 3	15 \pm 3
06/02/10 - 06/09/10	10 \pm 4	14 \pm 4	10 \pm 4
06/09/10 - 06/16/10	9 \pm 4	10 \pm 4	11 \pm 4
06/16/10 - 06/22/10	13 \pm 4	10 \pm 4	9 \pm 4
06/22/10 - 06/30/10	14 \pm 3	12 \pm 3	16 \pm 3
06/30/10 - 07/07/10	15 \pm 4	18 \pm 4	19 \pm 4
07/07/10 - 07/15/10	20 \pm 4	13 \pm 4	21 \pm 4
07/15/10 - 07/21/10	28 \pm 5	16 \pm 4	19 \pm 4
07/21/10 - 07/28/10	13 \pm 4	13 \pm 4	12 \pm 4
07/28/10 - 08/04/10	19 \pm 4	13 \pm 4	18 \pm 4
08/04/10 - 08/11/10	25 \pm 5	23 \pm 4	24 \pm 4
08/11/10 - 08/17/10	15 \pm 5	12 \pm 4	20 \pm 5
08/17/10 - 08/25/10	16 \pm 4	21 \pm 4	15 \pm 4
08/25/10 - 08/31/10	22 \pm 4	18 \pm 4	23 \pm 4
08/31/10 - 09/08/10	13 \pm 3	12 \pm 3	12 \pm 3
09/08/10 - 09/15/10	11 \pm 4	10 \pm 4	14 \pm 4
09/15/10 - 09/22/10	17 \pm 4	13 \pm 4	18 \pm 4
09/22/10 - 09/29/10	14 \pm 4	14 \pm 4	10 \pm 4
09/29/10 - 10/07/10	12 \pm 4	10 \pm 3	14 \pm 4
10/07/10 - 10/13/10	29 \pm 5	25 \pm 5	29 \pm 5
10/13/10 - 10/20/10	13 \pm 4	10 \pm 4	12 \pm 4
10/20/10 - 10/27/10	18 \pm 4	17 \pm 4	21 \pm 4
10/27/10 - 11/04/10	7 \pm 3	9 \pm 3	12 \pm 4
11/04/10 - 11/10/10	16 \pm 5	21 \pm 5	19 \pm 5
11/10/10 - 11/17/10	35 \pm 5	35 \pm 5	37 \pm 5
11/17/10 - 11/24/10	20 \pm 4	20 \pm 4	26 \pm 5
11/24/10 - 12/01/10	26 \pm 5	28 \pm 5	28 \pm 5
12/01/10 - 12/08/10	19 \pm 4	14 \pm 4	16 \pm 4
12/08/10 - 12/15/10	20 \pm 4	20 \pm 4	24 \pm 4
12/15/10 - 12/22/10	31 \pm 5	29 \pm 5	25 \pm 4
12/22/10 - 12/29/10	12 \pm 3	8 \pm 3	10 \pm 3
MEAN	17 \pm 13	16 \pm 13	17 \pm 14

TABLE C-IV.2 MONTHLY AND YEARLY MEAN VALUES OF GROSS BETA CONCENTRATIONS IN AIR PARTICULATE SAMPLES COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010
RESULTS IN UNITS OF E-3 PC/CU METER ± 2 SIGMA

GROUP I - ONSITE LOCATIONS

COLLECTION PERIOD	MIN	MAX	MEAN ± 2SD
12/30/09 - 02/03/10	17	43	24 ± 16
02/03/10 - 03/03/10	9	18	14 ± 6
03/03/10 - 03/31/10	11	17	15 ± 4
03/31/10 - 04/28/10	7	16	12 ± 5
04/28/10 - 06/02/10	8	17	12 ± 6
06/02/10 - 06/30/10	9	16	11 ± 4
06/30/10 - 07/28/10	12	28	17 ± 9
07/28/10 - 08/31/10	12	25	19 ± 8
08/31/10 - 09/29/10	10	18	13 ± 5
09/29/10 - 11/04/10	7	29	16 ± 14
11/04/10 - 12/01/10	16	37	26 ± 14
12/01/10 - 12/29/10	8	31	19 ± 14
12/30/09 - 12/29/10	7	43	17 ± 13

TABLE C-IV.3

CONCENTRATIONS OF GAMMA EMITTERS IN AIR PARTICULATE SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF E-3 PCI/CU METER ± 2 SIGMA

STC	COLLECTION PERIOD	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
Z-01	12/30/09 - 03/31/10	< 3	< 4	< 12	< 3	< 7	< 5	< 6	< 4	< 3	< 69	< 22
	03/31/10 - 06/30/10	< 3	< 4	< 12	< 2	< 7	< 5	< 7	< 3	< 3	< 182	< 82
	06/30/10 - 09/29/10	< 3	< 6	< 34	< 2	< 9	< 7	< 11	< 3	< 2	< 3920	< 1320
	09/29/10 - 12/29/10	< 3	< 3	< 5	< 2	< 5	< 2	< 5	< 2	< 2	< 35	< 10
	MEAN	-	-	-	-	-	-	-	-	-	-	-
Z-02	12/30/09 - 03/31/10	< 2	< 3	< 11	< 3	< 5	< 4	< 7	< 3	< 2	< 60	< 22
	03/31/10 - 06/30/10	< 2	< 4	< 10	< 3	< 7	< 3	< 6	< 2	< 2	< 166	< 68
	06/30/10 - 09/29/10	< 3	< 7	< 32	< 3	< 7	< 9	< 17	< 3	< 3	< 4170	< 1260
	09/29/10 - 12/29/10	< 3	< 3	< 4	< 3	< 7	< 3	< 7	< 3	< 2	< 34	< 11
	MEAN	-	-	-	-	-	-	-	-	-	-	-
Z-03	12/30/09 - 03/31/10	< 3	< 4	< 10	< 3	< 7	< 5	< 6	< 3	< 2	< 60	< 23
	03/31/10 - 06/30/10	< 2	< 4	< 9	< 3	< 6	< 4	< 6	< 2	< 2	< 185	< 69
	06/30/10 - 09/29/10	< 2	< 5	< 27	< 2	< 5	< 8	< 12	< 2	< 2	< 3890	< 795
	09/29/10 - 12/29/10	< 3	< 4	< 6	< 3	< 9	< 4	< 6	< 3	< 3	< 43	< 19
	MEAN	-	-	-	-	-	-	-	-	-	-	-

TABLE C-V.1 QUARTERLY TLD RESULTS FOR ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF MILLI-ROETGEN/QUARTER \pm 2 STANDARD DEVIATIONS

STATION CODE	MEAN \pm 2 S.D.	JAN - MAR	APR - JUN	JUL - SEP	OCT - DEC
Z-01-1	19.8 \pm 5.3	22	22	17	18
Z-01-2	21.0 \pm 6.3	22	25	18	19
Z-02-1	18.8 \pm 6.0	20	22	15	18
Z-02-2	18.5 \pm 3.5	20	20	17	17
Z-03-1	18.3 \pm 6.0	19	22	15	17
Z-03-2	19.5 \pm 5.3	18	23	17	20
Z-101-1	19.8 \pm 7.7	22	24	16	17
Z-101-2	20.5 \pm 8.2	21	25	15	21
Z-102-1	21.0 \pm 7.1	24	24	17	19
Z-102-2	20.5 \pm 6.0	23	23	17	19
Z-103-1	20.3 \pm 6.6	22	24	17	18
Z-103-2	20.0 \pm 4.6	22	22	18	18
Z-104-1	18.3 \pm 7.2	19	23	15	16
Z-104-2	19.0 \pm 5.9	21	22	16	17
Z-105-1	19.3 \pm 6.4	22	22	16	17
Z-105-2	19.5 \pm 5.0	20	22	16	20
Z-106-1	20.0 \pm 4.6	22	22	18	18
Z-106-2	20.8 \pm 5.5	22	24	19	18
Z-107-1	19.3 \pm 5.5	21	22	16	18
Z-107-2	20.0 \pm 4.6	22	22	18	18
Z-108-1	20.3 \pm 6.6	22	24	18	17
Z-108-2	20.8 \pm 6.6	23	24	17	19
Z-110-1	20.3 \pm 7.7	22	24	15	20
Z-110-2	21.0 \pm 5.9	24	23	19	18
Z-111-1	19.5 \pm 4.8	21	22	18	17
Z-111-2	20.0 \pm 9.1	21	26	16	17
Z-112-1	21.0 \pm 4.9	22	24	19	19
Z-112-2	21.0 \pm 5.9	23	24	18	19
Z-113-1	19.5 \pm 5.3	21	22	16	19
Z-113-2	20.5 \pm 7.0	23	24	17	18
Z-114-1	21.3 \pm 6.6	23	25	18	19
Z-114-2	20.8 \pm 5.5	22	24	19	18
Z-115-1	21.5 \pm 5.3	23	24	18	21
Z-115-2	21.3 \pm 4.4	22	23	18	22
Z-301-1	22.7 \pm 4.6	24	24	20	21
Z-301-2	23.0 \pm 6.3	24	27	21	20

TABLE C-V.2 MEAN QUARTERLY TLD RESULTS FOR INNER RING AND OTHER LOCATIONS FOR ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF MILLI-ROENTGEN/QUARTER
STANDARD DEVIATIONS OF THE STATION DATA

COLLECTION PERIOD	INNER RING ± 2 S.D.	OTHER
JAN-MAR	22.1 ± 2.4	20.2 ± 3.2
APR-JUN	23.5 ± 2.6	22.3 ± 3.3
JUL-SEP	17.4 ± 3.0	16.5 ± 2.4
OCT-DEC	18.6 ± 2.9	18.2 ± 2.3

TABLE C-V.3 SUMMARY OF THE AMBIENT DOSIMETRY PROGRAM FOR ZION NUCLEAR POWER STATION, 2010

RESULTS IN UNITS OF MILLI-ROENTGEN/QUARTER


LOCATION	SAMPLES ANALYZED	PERIOD MINIMUM	PERIOD MAXIMUM	PERIOD MEAN ± 2 S.D.
INNER RING	120	15	27	20.4 ± 5.7
OTHER	24	15	25	19.3 ± 5.2

INNER RING STATIONS - Z-101-1, Z-101-2, Z-102-1, Z-102-2, Z-103-1, Z-103-2, Z-104-1, Z-104-2, Z-105-1, Z-105-2, Z-106-1, Z-106-2, Z-107-1, Z-107-2, Z-108-1, Z-108-2, Z-110-1, Z-110-2, Z-111-1, Z-111-2, Z-112-1, Z-112-2, Z-113-1, Z-113-2, Z-114-1, Z-114-2, Z-115-1, Z-115-2, Z-301-1, Z-301-2


OTHER STATIONS - Z-01-1, Z-01-2, Z-02-1, Z-02-2, Z-03-1, Z-03-2

**FIGURE C-1
PUBLIC WATER - GROSS BETA - STATIONS Z-14 AND
Z-15 COLLECTED IN THE VICINITY OF ZNPS, 2000-2004**

Z-14 Kenosha Water Works

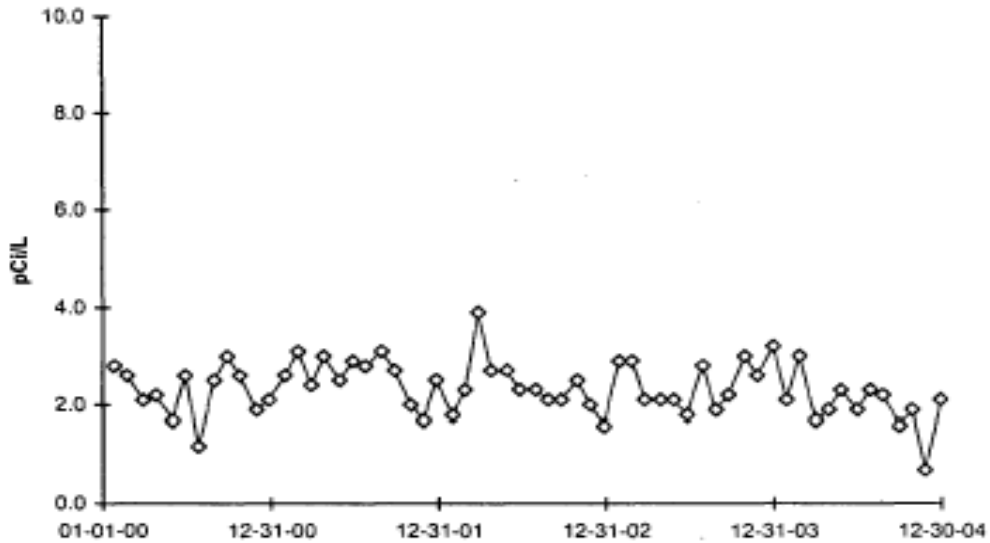


Z-15 Lake County Water Works

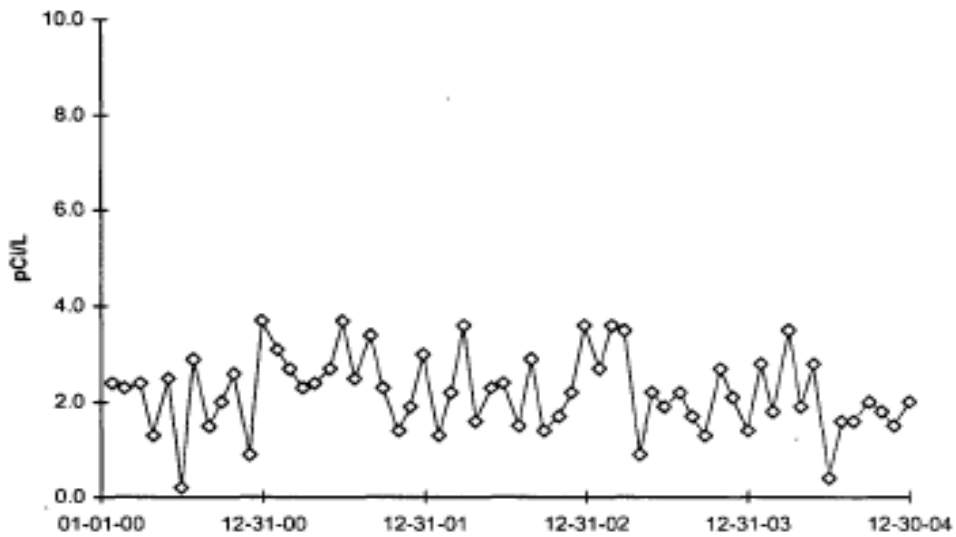


**FIGURE C-1 (cont.)
PUBLIC WATER - GROSS BETA - STATIONS Z-14 AND
Z-15 COLLECTED IN THE VICINITY OF ZNPS, 2005 - 2010**

Z-14 (C) Kenosha Water Works

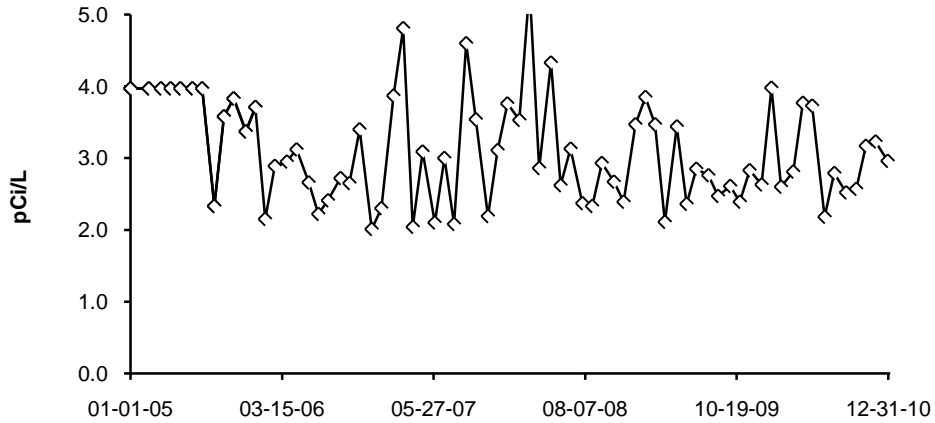


Z-15 Lake County Water Works

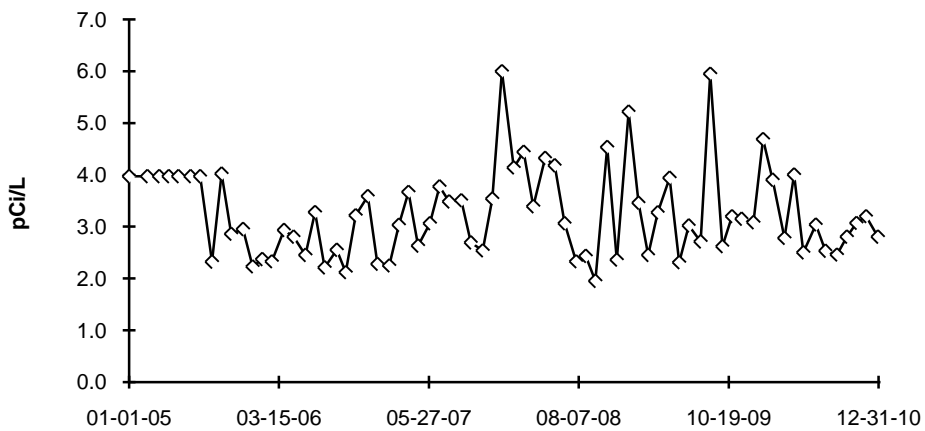

DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

**FIGURE C-2
PUBLIC WATER - GROSS BETA - STATIONS Z-16 AND
Z-18 COLLECTED IN THE VICINITY OF ZNPS, 2000 - 2004**

Z-16 Waukegan Water Works

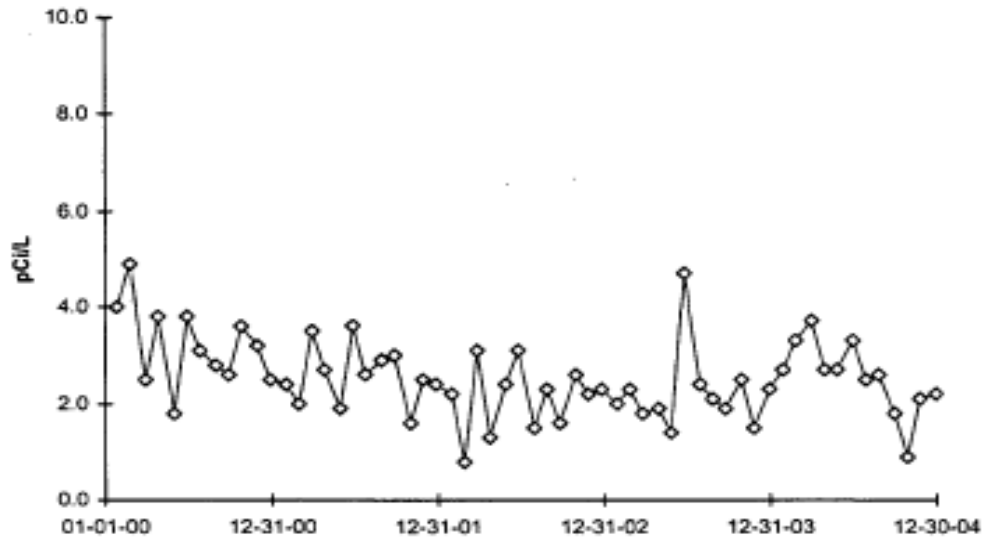

Z-18 Lake Forest Water Works



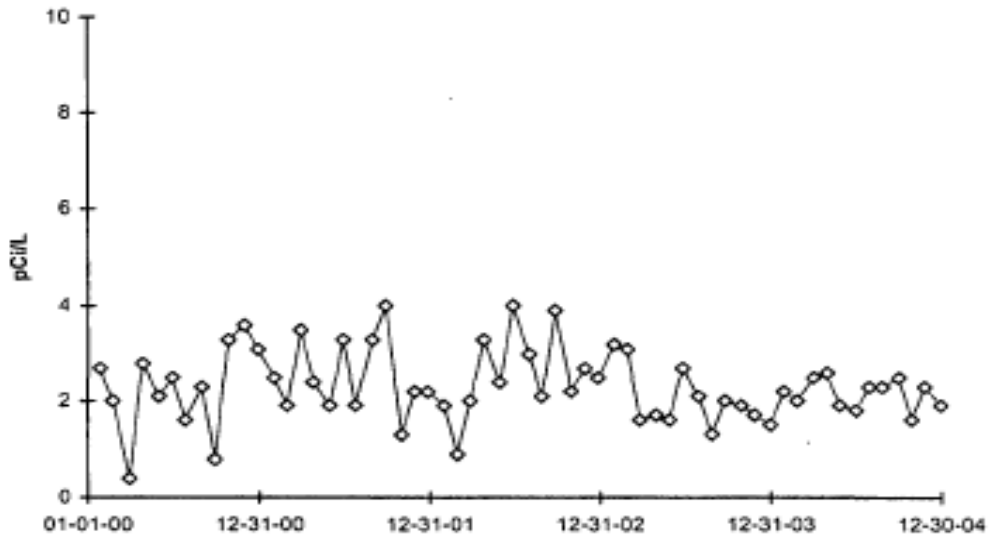


FIGURE C-2 (cont.)
PUBLIC WATER - GROSS BETA - STATIONS Z-16 AND
Z-18 COLLECTED IN THE VICINITY OF ZNPS, 2005 - 2010

Z-16 Waukegan Water Works

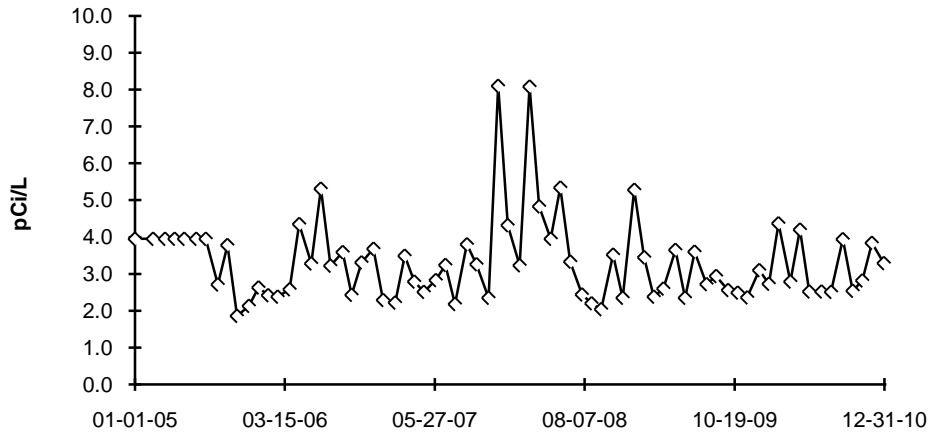


Z-18 (C) Lake Forest Water Works

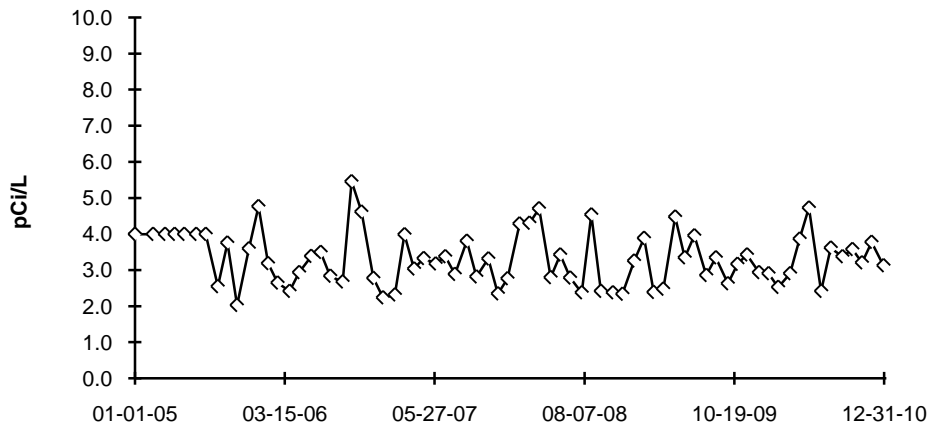


DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

**FIGURE C-3
PUBLIC WATER - TRITIUM - STATION Z-14 AND Z-15
COLLECTED IN THE VICINITY OF ZNPS, 2000 - 2004**

Z-14 (C) Kenosha Water Works

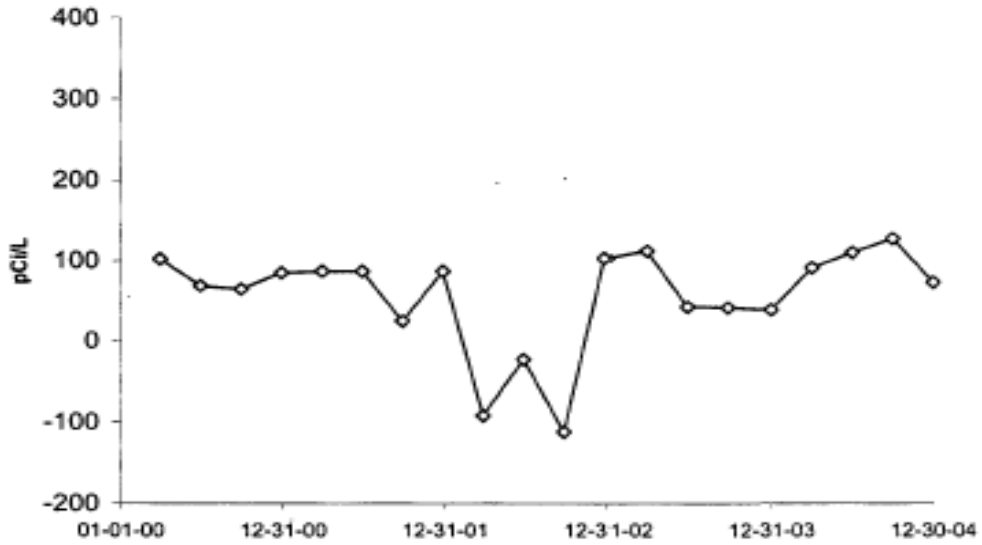


Z-15 Lake County Water Works

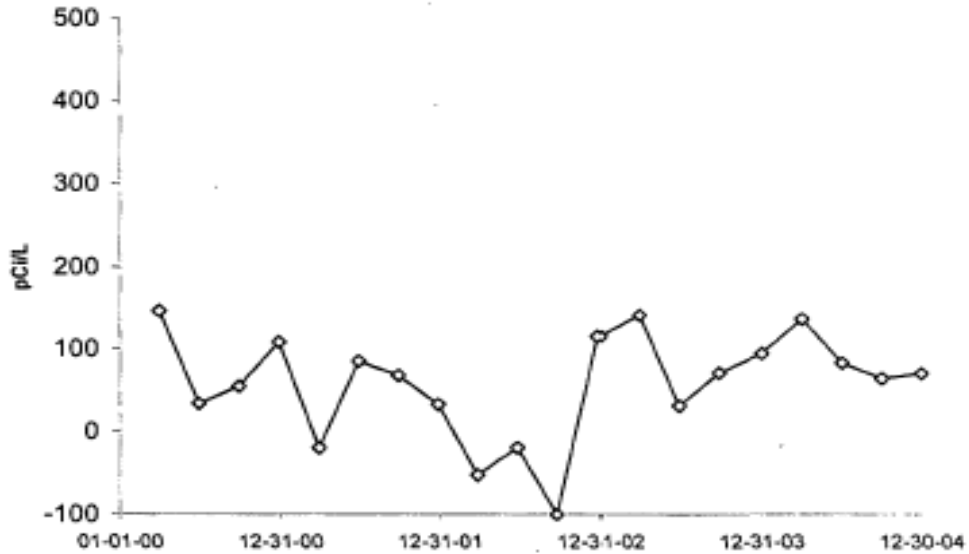


**FIGURE C-3 (cont.)
PUBLIC WATER - TRITIUM - STATION Z-14 AND Z-15
COLLECTED IN THE VICINITY OF ZNPS, 2005 - 2010**

Z-14 (C) Kenosha Water Works

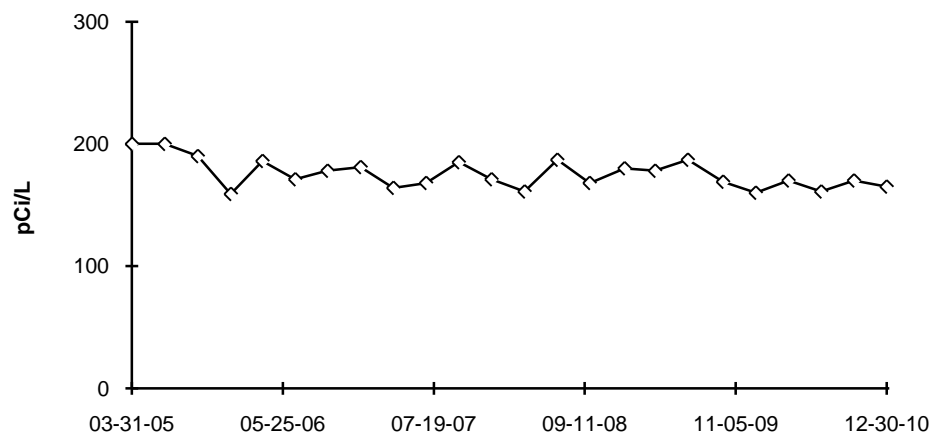


Z-15 Lake County Water Works

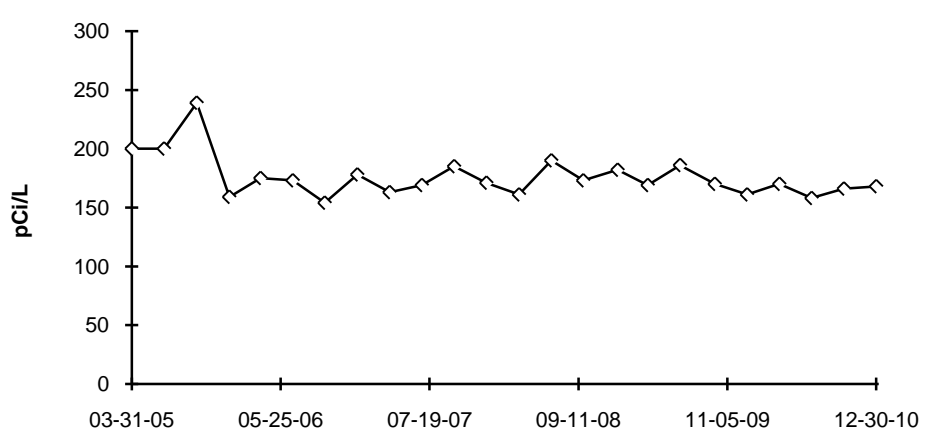


DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

**FIGURE C-4
PUBLIC WATER - TRITIUM - STATION Z-16 AND Z-18
COLLECTED IN THE VICINITY OF ZNPS, 2000 - 2004**

Z-16 Waukegan Water Works

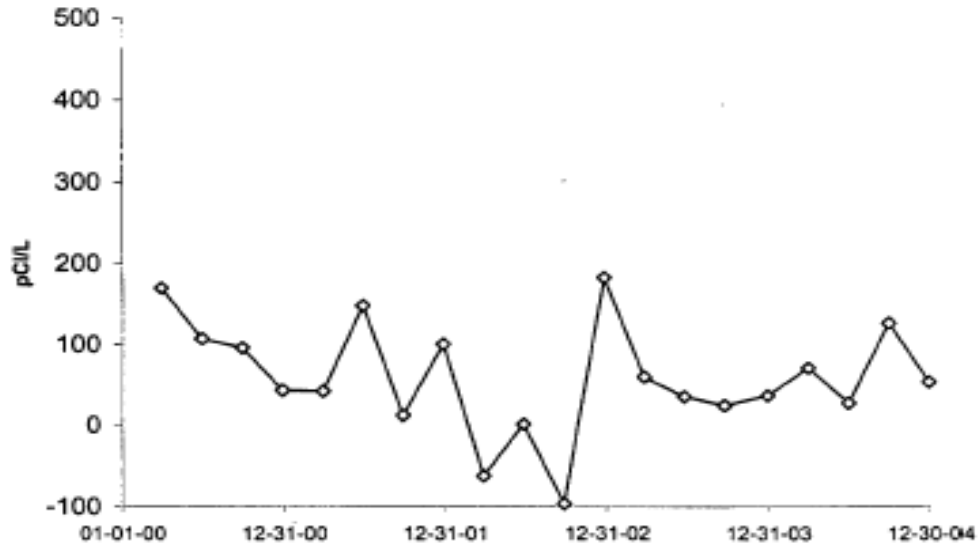


Z-18 (C) Lake Forest Water Works

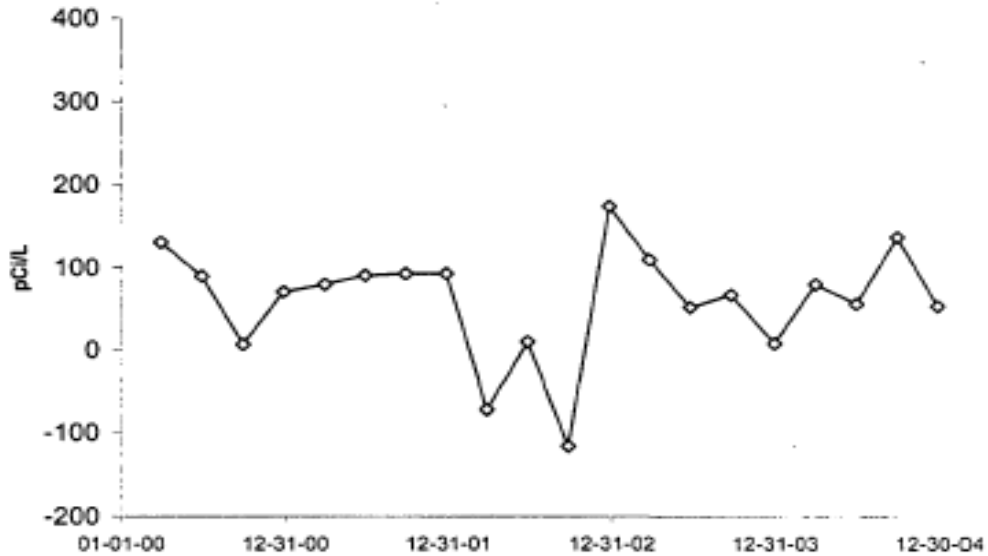


**FIGURE C-4 (cont.)
PUBLIC WATER - TRITIUM - STATION Z-16 AND Z-18
COLLECTED IN THE VICINITY OF ZNPS, 2005 - 2010**

Z-16 Waukegan Water Works

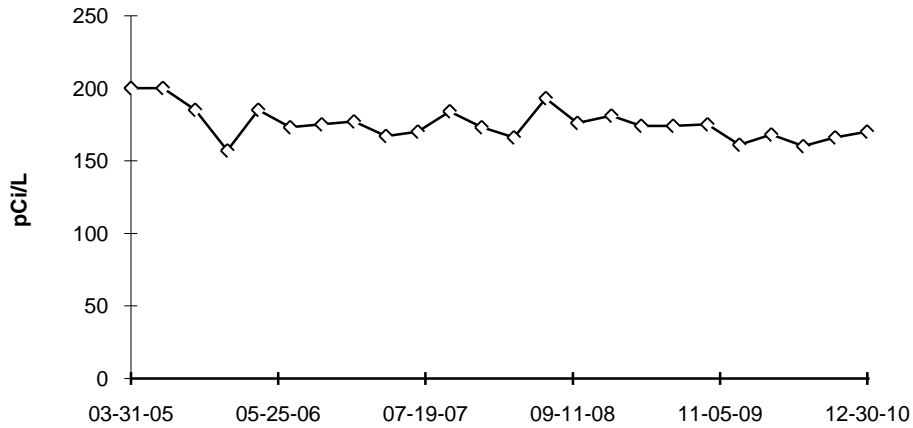


Z-18 (C) Lake Forest Water Works

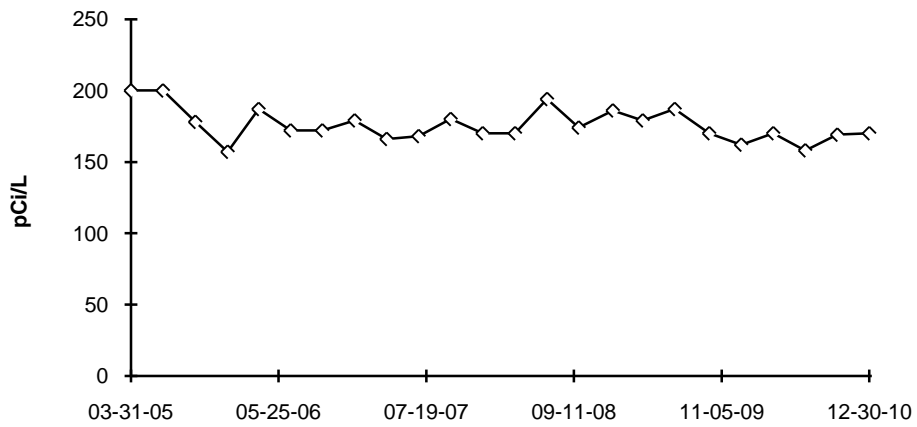

DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

FIGURE C-5
AIR PARTICULATES - GROSS BETA - STATIONS Z-01 AND
Z-02 COLLECTED IN THE VICINITY OF ZNPS, 2000 - 2004

Z-01 Onsite No. 1, Southside

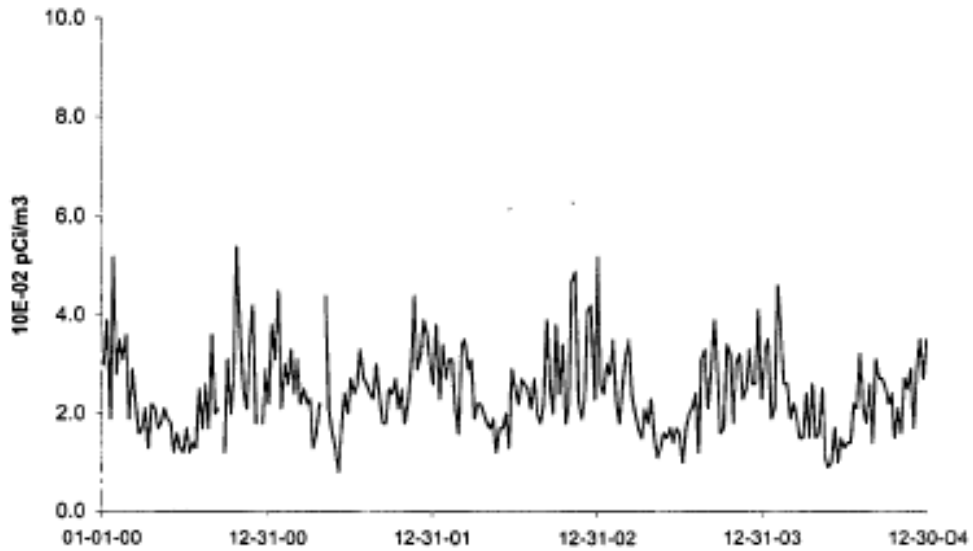

Z-02 Onsite No. 2, Westside



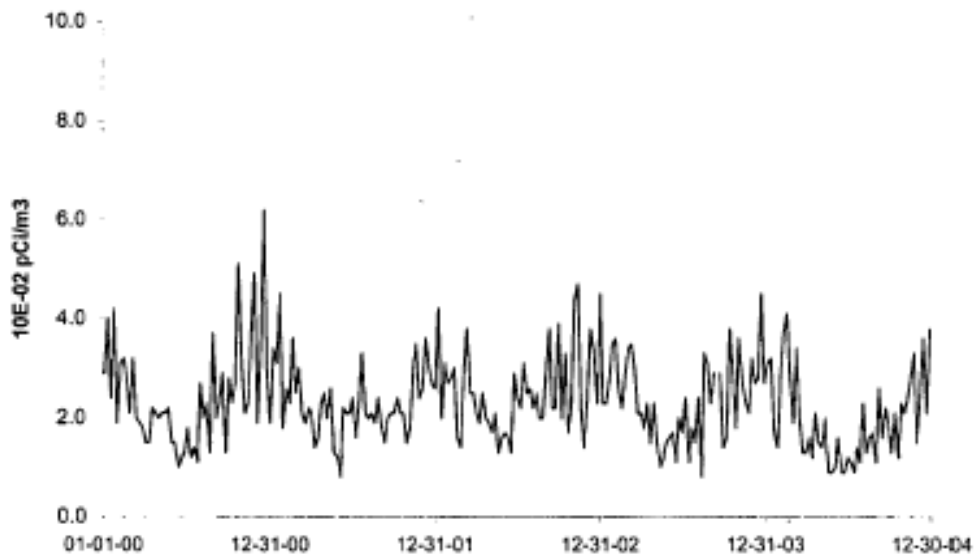


FIGURE C-5 (cont.)
AIR PARTICULATES - GROSS BETA - STATIONS Z-01 AND
Z-02 COLLECTED IN THE VICINITY OF ZNPS, 2005 - 2010

Z-01 Onsite No. 1, Southside

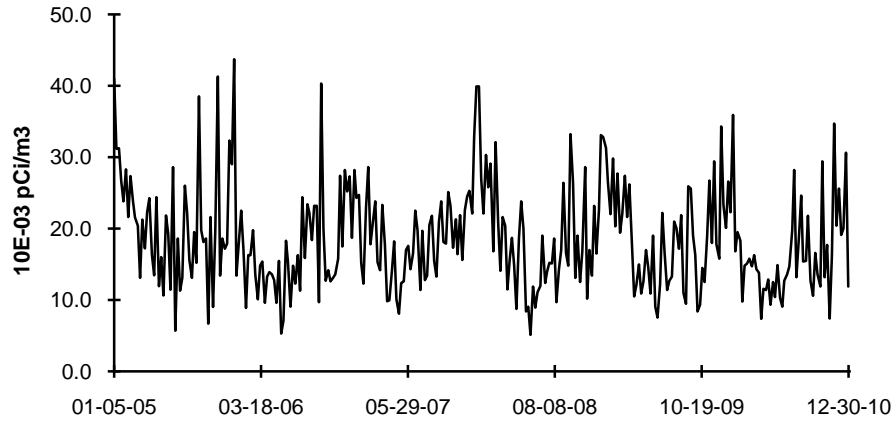


Z-02 Onsite No. 2, Westside

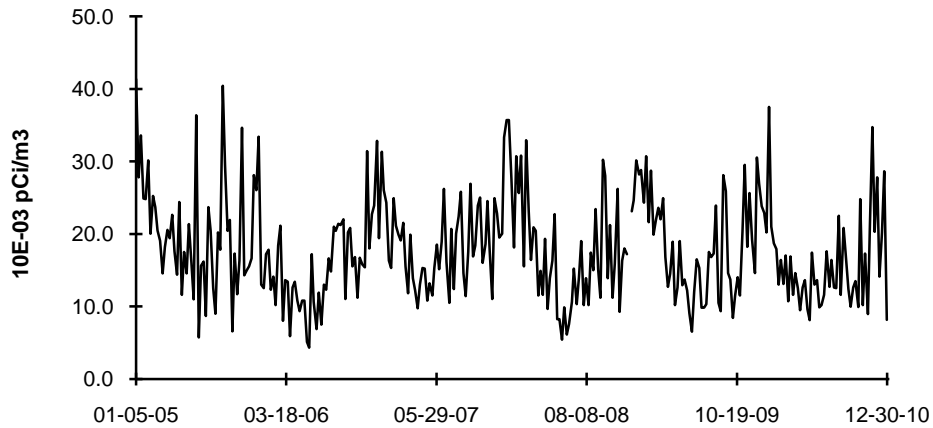

DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005


FIGURE C-6
AIR PARTICULATES - GROSS BETA - STATIONS Z-03
COLLECTED IN THE VICINITY OF ZNPS, 2000 - 2004

Z-03 Onsite No. 3, Northside

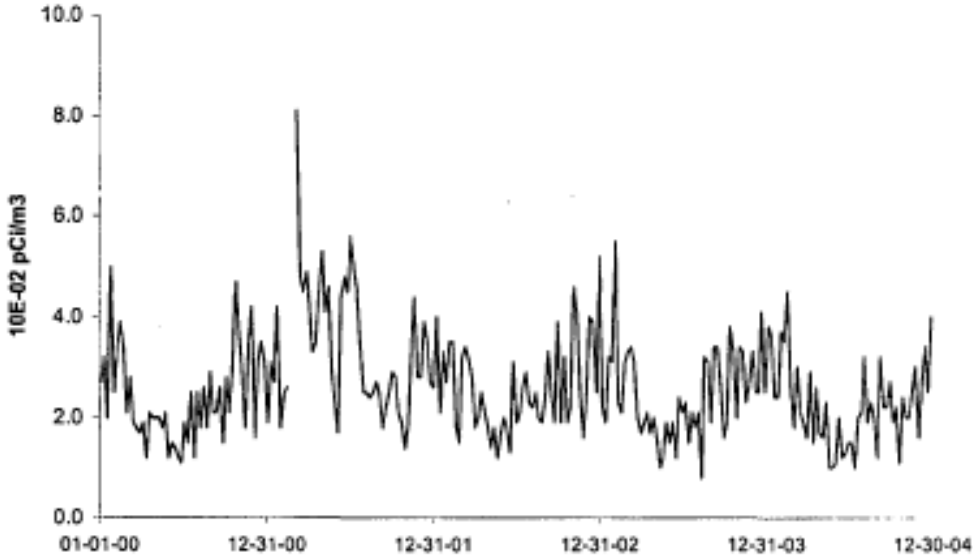

**FIGURE C-6 (cont.)
AIR PARTICULATES - GROSS BETA - STATIONS Z-03
COLLECTED IN THE VICINITY OF ZNPS, 2005 - 2010**

Z-03 Onsite No. 3, Northside

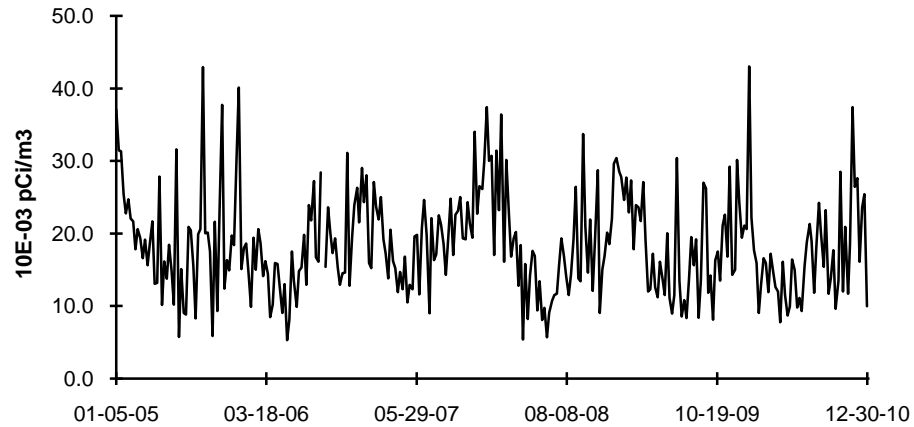

DUE TO VENDOR CHANGE IN 2005, < VALUES ARE LLD VALUES JANUARY THROUGH JUNE 2005 AND MDC VALUES AFTER JUNE 2005

APPENDIX D

INTER-LABORATORY COMPARISON PROGRAM

TABLE D-1

**ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2010**

(PAGE 1 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)			
March 2010	E6978-396	Milk	Sr-89	pCi/L	89.3	92.8	0.96	A			
			Sr-90	pCi/L	13.8	12.7	1.09	A			
March 2010	E6979-396	Milk	I-131	pCi/L	65.2	74.0	0.88	A			
			Ce-141	pCi/L	241	261	0.92	A			
			Cr-51	pCi/L	388	361	1.07	A			
			Cs-134	pCi/L	157	178	0.88	A			
			Cs-137	pCi/L	150	158	0.95	A			
			Co-58	pCi/L	143	143	1.00	A			
			Mn-54	pCi/L	202	207	0.98	A			
			Fe-59	pCi/L	146	137	1.07	A			
			Zn-65	pCi/L	247	254	0.97	A			
			Co-60	pCi/L	177	183	0.97	A			
			March 2010	E6981-396	AP	Ce-141	pCi	211	185	1.14	A
						Cr-51	pCi	304	255	1.19	A
						Cs-134	pCi	142	125	1.14	A
						Cs-137	pCi	131	111	1.18	A
Co-58	pCi	119				101	1.18	A			
Mn-54	pCi	162				146	1.11	A			
Fe-59	pCi	110				97	1.14	A			
Zn-65	pCi	217				179	1.21	W			
Co-60	pCi	145	129	1.12	A						
March 2010	E6980-396	Charcoal	I-131	pCi	80.2	85.6	0.94	A			
June 2010	E7132-396	Milk	Sr-89	pCi/L	82.0	93.4	0.88	A			
			Sr-90	pCi/L	15.8	16.7	0.95	A			
June 2010	E7133-396	Milk	I-131	pCi/L	83.5	96.9	0.86	A			
			Ce-141	pCi/L	107	110	0.97	A			
			Cr-51	pCi/L	325	339	0.96	A			
			Cs-134	pCi/L	114	126	0.90	A			
			Cs-137	pCi/L	144	150	0.96	A			
			Co-58	pCi/L	92.3	101	0.91	A			
			Mn-54	pCi/L	165	169	0.98	A			
			Fe-59	pCi/L	121	119	1.02	A			
			Zn-65	pCi/L	197	206	0.96	A			
			Co-60	pCi/L	190	197	0.96	A			
			June 2010	E7135-396	AP	Ce-141	pCi	88.4	91.6	0.97	A
						Cr-51	pCi	292	282	1.04	A
						Cs-134	pCi	101	105	0.96	A
						Cs-137	pCi	132	125	1.06	A
Co-58	pCi	87.3				84.0	1.04	A			
Mn-54	pCi	150				140	1.07	A			
Fe-59	pCi	105				98.6	1.06	A			
Zn-65	pCi	168				171	0.98	A			
Co-60	pCi	170	163	1.04	A						
June 2010	E7134-396	Charcoal	I-131	pCi	76.4	79.9	0.96	A			

**TABLE D-1 ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2010
(PAGE 2 OF 3)**

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)			
September 2010	E7229-396	Milk	Sr-89	pCi/L	85.0	92.8	0.92	A			
			Sr-90	pCi/L	12.6	14.7	0.86	A			
September 2010	E7230-396	Milk	I-131	pCi/L	80.2	94.1	0.85	A			
			Ce-141	pCi/L	130	130	1.00	A			
			Cr-51	pCi/L	235	234	1.00	A			
			Cs-134	pCi/L	83.2	93.0	0.89	A			
			Cs-137	pCi/L	95.1	94.5	1.01	A			
			Co-58	pCi/L	77.3	73.7	1.05	A			
			Mn-54	pCi/L	121	119	1.02	A			
			Fe-59	pCi/L	96.4	91.1	1.06	A			
			Zn-65	pCi/L	216	204	1.06	A			
			Co-60	pCi/L	172	171	1.01	A			
			September 2010	E7232-396	AP	Ce-141	pCi	122	119	1.03	A
						Cr-51	pCi	228	214	1.07	A
						Cs-134	pCi	79.9	85.3	0.94	A
						Cs-137	pCi	93.8	86.7	1.08	A
Co-58	pCi	71.5				67.6	1.06	A			
Mn-54	pCi	113				110	1.03	A			
Fe-59	pCi	73.8				83.6	0.88	A			
Zn-65	pCi	186				187	0.99	A			
September 2010	E7231-396	Charcoal	I-131	pCi/L	62.3	59.9	1.04	A			
December 2010	E7375-396	Milk	Sr-89	pCi/L	92.7	98.0	0.95	A			
			Sr-90	pCi/L	13.5	13.5	1.00	A			
December 2010	E7376-396	Milk	I-131	pCi/L	87.9	96.9	0.91	A			
			Ce-141	pCi/L	not provided by Analytics for this study						
			Cr-51	pCi/L	389	456	0.85	A			
			Cs-134	pCi/L	137	157	0.87	A			
			Cs-137	pCi/L	172	186	0.92	A			
			Co-58	pCi/L	84.3	90.2	0.93	A			
			Mn-54	pCi/L	120	120	1.00	A			
			Fe-59	pCi/L	134	131	1.02	A			
			Zn-65	pCi/L	162	174	0.93	A			
			Co-60	pCi/L	284	301	0.94	A			
December 2010	E7378-396	AP	Ce-141	pCi	not provided by Analytics for this study						
			Cr-51	pCi	387	365	1.06	A			
			Cs-134	pCi	135	126	1.07	A			
			Cs-137	pCi	157	149	1.05	A			
			Co-58	pCi	73.6	72.3	1.02	A			
			Mn-54	pCi	88.7	96	0.92	A			
			Fe-59	pCi	127	105	1.21	W			
			Zn-65	pCi	151	139	1.09	A			
Co-60	pCi	249	241	1.03	A						

TABLE D-1

ANALYTICS ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2010

(PAGE 3 OF 3)

Month/Year	Identification Number	Matrix	Nuclide	Units	Reported Value (a)	Known Value (b)	Ratio (c) TBE/Analytics	Evaluation (d)
December 2010	E7377-396	Charcoal	I-131	pCi	79.6	84.2	0.95	A

(a) Teledyne Brown Engineering reported result.

(b) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) Ratio of Teledyne Brown Engineering to Analytics results.

(d) Analytics evaluation based on TBE internal QC limits: A= Acceptable. Reported result falls within ratio limits of 0.80-1.20. W=Acceptable with warning. Reported result falls within 0.70-0.80 or 1.20-1.30. N = Not Acceptable. Reported result falls outside the ratio limits of < 0.70 and > 1.30.

TABLE D-2

**ERA ENVIRONMENTAL RADIOACTIVITY CROSS CHECK PROGRAM
TELEDYNE BROWN ENGINEERING, 2010**

(PAGE 1 OF 1)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Control Limits	Evaluation (c)
May 2010	RAD-81	Water	Sr-89	pCi/L	64.4	60.4	48.6 - 68.2	A
			Sr-90	pCi/L	37.8	41.3	30.4 - 47.4	A
			Ba-133	pCi/L	66.4	65.9	54.9 - 72.5	A
			Cs-134	pCi/L	66.43	71.6	58.4 - 78.8	A
			Cs-137	pCi/L	137.33	146	131 - 163	A
			Co-60	pCi/L	83.33	84.5	76.0 - 95.3	A
			Zn-65	pCi/L	177	186	167 - 219	A
			Gr-A	pCi/L	26.37	32.9	16.9 - 42.6	A
			Gr-B	pCi/L	28.77	37.5	24.7 - 45.0	A
			I-131	pCi/L	26.27	26.4	21.9 - 31.1	A
			H-3	pCi/L	12967	12400	10800 - 13600	A
November 2010	RAD-83	Water	Sr-89	pCi/L	77.8	68.5	55.8 - 76.7	N (1)
			Sr-90	pCi/L	39.3	43.0	31.7 - 49.3	A
			Ba-133	pCi/L	70.3	68.9	57.5 - 75.8	A
			Cs-134	pCi/L	39.9	43.2	34.5 - 47.5	A
			Cs-137	pCi/L	117	123	111 - 138	A
			Co-60	pCi/L	53.5	53.4	48.1 - 61.3	A
			Zn-65	pCi/L	11.0	102	91.8 - 122	N (2)
			Gr-A	pCi/L	35.1	42.3	21.9 - 53.7	A
			Gr-B	pCi/L	35.5	36.6	24.0 - 44.2	A
			I-131	pCi/L	27.9	27.5	22.9 - 32.3	A
			H-3	pCi/L	13233	12900	11200 - 14200	A

(1) Sr-89 TBE to known ratio of 1.14 fell within acceptable range of $\pm 20\%$. No action required. NCR 10-09

(2) Zn-65 result of 111 was incorrectly reported as 11.0. No action required. NCR 10-09

(a) Teledyne Brown Engineering reported result.

(b) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) ERA evaluation: A=acceptable. Reported result falls within the Warning Limits. NA=not acceptable. Reported result falls outside of the Control Limits. CE=check for Error. Reported result falls within the Control Limits and outside of the Warning Limit.

TABLE D-3

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)
TELEDYNE BROWN ENGINEERING, 2010

(PAGE 1 OF 2)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Range	Evaluation (c)
March 2010	10-MaW22	Water	Cs-134	Bq/L	-0.0942		(1)	A
			Cs-137	Bq/L	58.5	60.6	42.4 - 78.8	A
			Co-57	Bq/L	27.2	28.3	19.8 - 36.8	A
			Co-60	Bq/L	0.0226		(1)	A
			H-3	Bq/L	104	90.8	63.6 - 118.0	A
			Mn-54	Bq/L	26.6	26.9	18.8 - 35.0	A
			Sr-90	Bq/L	0.1029		(1)	A
			Zn-65	Bq/L	42.0	40.7	28.5 - 52.9	A
	10-GrW22	Water	Gr-A	Bq/L	0.5173	0.676	0.00 - 1.352	A
			Gr-B	Bq/L	3.98	3.09	1.55 - 4.64	A
	10-MaS22	Soil	Cs-134	Bq/kg	665	733	513 - 953	A
			Cs-137	Bq/kg	800	779	545 - 1013	A
			Co-57	Bq/kg	508	522	365 - 679	A
			Co-60	Bq/kg	648	622	435 - 809	A
			Mn-54	Bq/kg	893	849	594 - 1104	A
			K-40	Bq/kg	597	559	391 - 727	A
			Sr-90	Bq/kg	221	288	202 - 374	W
			Zn-65	Bq/kg	-4.97		(1)	A
	10-RdF22	AP	Cs-134	Bq/sample	1.81	2.13	1.49 - 2.77	A
			Cs-137	Bq/sample	1.70	1.53	1.07 - 1.99	A
			Co-57	Bq/sample	0.0056		(1)	A
			Co-60	Bq/sample	2.65	2.473	1.731 - 3.215	A
			Mn-54	Bq/sample	3.70	3.02	2.11 - 3.93	W
			Sr-90	Bq/sample	0.0523		(1)	A
			Zn-65	Bq/sample	-0.0627		(1)	A
	10-GrF22	AP	Gr-A	Bq/sample	0.1533	0.0427	0.00 - 0.854	A
			Gr-B	Bq/sample	1.240	1.29	0.65 - 1.94	A
	10-RdV22	Vegetation	Cs-134	Bq/sample	4.48	4.39	3.07 - 5.71	A
			Cs-137	Bq/sample	3.43	3.06	2.14 - 3.98	A
			Co-57	Bq/sample	-0.0117		(1)	A
Co-60			Bq/sample	3.55	3.27	2.29 - 4.25	A	
Mn-54			Bq/sample	0.007		(1)	A	
Sr-90			Bq/sample	-0.0002		(1)	A	
Zn-65			Bq/sample	8.12	7.10	4.97 - 9.23	A	
September 2010	10-MaW23	Water	Cs-134	Bq/L	27.1	31.4	22.0 - 40.8	A
			Cs-137	Bq/L	41.8	44.2	30.9 - 57.5	A
			Co-57	Bq/L	33.2	36.0	25.2 - 46.8	A
			Co-60	Bq/L	26.5	28.3	19.8 - 36.8	A
			H-3	Bq/L	500	453.4	317.4 - 589.4	A
			Mn-54	Bq/L	0.024		(1)	A
			Sr-90	Bq/L	8.10	8.3	5.8 - 10.8	A
			Zn-65	Bq/L	30.8	31.0	21.7 - 40.3	A
	10-GrW23	Water	Gr-A	Bq/L	2.36	1.92	0.58 - 3.26	A
			Gr-B	Bq/L	6.37	4.39	2.20 - 6.59	A

TABLE D-3

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)
TELEDYNE BROWN ENGINEERING, 2010

(PAGE 2 OF 2)

Month/Year	Identification Number	Media	Nuclide	Units	Reported Value (a)	Known Value (b)	Acceptance Range	Evaluation (c)
September 2010	10-MaS23	Soil	Cs-134	Bq/kg	837	940	658 - 1222	A
			Cs-137	Bq/kg	680	670	469 - 871	A
			Co-57	Bq/kg	2.78		(1)	A
			Co-60	Bq/kg	350	343	240 - 446	A
			Mn-54	Bq/kg	853	820	574 - 1066	A
			K-40	Bq/kg	721	699	489 - 909	A
			Sr-90	Bq/kg	2.24		(1)	A
			Zn-65	Bq/kg	287	265	186 - 345	A
	10-RdF23	AP	Cs-134	Bq/sample	2.31	2.98	2.09 - 3.87	W
			Cs-137	Bq/sample	-0.025		(1)	A
			Co-57	Bq/sample	3.64	4.08	2.86 - 5.380	A
			Co-60	Bq/sample	2.81	2.92	2.04 - 3.80	A
			Mn-54	Bq/sample	3.19	3.18	2.23- 4.13	A
			Sr-90	Bq/sample	1.01	1.01	0.71 - 1.31	A
			Zn-65	Bq/sample	0.0310		(1)	A
			10-GrF23	AP	Gr-A	Bq/sample	0.004	
	Gr-B	Bq/sample			0.473	0.50	0.25 - 0.75	A
	10-RdV23	Vegetation	Cs-134	Bq/sample	4.90	4.79	3.35 - 6.23	A
			Cs-137	Bq/sample	6.78	5.88	4.12 - 7.64	A
			Co-57	Bq/sample	10.2	8.27	5.79 - 10.75	W
			Co-60	Bq/sample	0.00		(1)	A
			Mn-54	Bq/sample	7.36	6.287	4.401 - 8.173	A
			Sr-90	Bq/sample	2.53	2.63	1.84 - 3.42	A
			Zn-65	Bq/sample	6.40	5.3900	3.77 - 7.01	A

(1) False positive test.

(a) Teledyne Brown Engineering reported result.

(b) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(c) DOE/MAPEP evaluation: A=acceptable, W=acceptable with warning, N=not acceptable.

TABLE D-4

ERA (a) STATISTICAL SUMMARY PROFICIENCY TESTING PROGRAM^a
ENVIRONMENTAL, INC., 2010
 (Page 1 of 1)

Lab Code	Date	Analysis	Concentration (pCi/L)			Acceptance
			Laboratory Result ^b	ERA Result ^c	Control Limits	
STW-1205	04/05/10	Sr-89	63.0 ± 5.7	60.4	48.6 - 68.2	Pass
STW-1205	04/05/10	Sr-90	37.4 ± 2.4	41.3	30.4 - 47.4	Pass
STW-1206	04/05/10	Ba-133	63.6 ± 3.3	65.9	54.9 - 72.5	Pass
STW-1206	04/05/10	Co-60	83.3 ± 2.9	84.5	76.0 - 95.3	Pass
STW-1206	04/05/10	Cs-134	71.0 ± 3.4	71.6	58.4 - 78.8	Pass
STW-1206	04/05/10	Cs-137	145.5 ± 5.1	146.0	131.0 - 163.0	Pass
STW-1206	04/05/10	Zn-65	194.9 ± 7.8	186.0	167.0 - 219.0	Pass
STW-1207	04/05/10	Gr. Alpha	26.5 ± 1.7	32.9	16.9 - 42.6	Pass
STW-1207	04/05/10	Gr. Beta	34.5 ± 1.6	37.5	24.7 - 45.0	Pass
STW-1208	04/05/10	I-131	22.7 ± 0.8	26.4	21.9 - 31.1	Pass
STW-1210	04/05/10	H-3	12955 ± 332	12400.0	10800 - 13600	Pass
STW-1224	10/04/10	Sr-89	65.3 ± 5.7	68.5	55.8 - 76.7	Pass
STW-1224	10/04/10	Sr-90	39.9 ± 2.3	43.0	31.7 - 49.3	Pass
STW-1225	10/04/10	Ba-133	67.2 ± 4.3	68.9	57.5 - 75.8	Pass
STW-1225	10/04/10	Co-60	53.2 ± 3.3	53.4	48.1 - 61.3	Pass
STW-1225	10/04/10	Cs-134	47.3 ± 5.1	43.2	34.5 - 47.5	Pass
STW-1225	10/04/10	Cs-137	118.0 ± 5.9	123.0	111.0 - 138.0	Pass
STW-1225	10/04/10	Zn-65	107.0 ± 8.7	102.0	91.8 - 122.0	Pass
STW-1226	10/04/10	Gr. Alpha	30.7 ± 2.9	42.3	21.9 - 53.7	Pass
STW-1226	10/04/10	Gr. Beta	32.7 ± 0.8	36.6	24.0 - 44.2	Pass
STW-1227	10/04/10	I-131	28.6 ± 1.1	27.5	22.9 - 32.3	Pass
STW-1229	10/04/10	H-3	13682 ± 352	12900.0	11200 - 14200	Pass

^a Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the crosscheck program for proficiency testing in drinking water conducted by Environmental Resources Associates (ERA).

^b Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

^c Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA.

TABLE D-5

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)^a
ENVIRONMENTAL, INC., 2010

(Page 1 of 3)

Lab Code ^c	Date	Analysis	Laboratory result	Concentration ^b		Acceptance
				Known Activity	Control Limits ^d	
STVE-1199	03/01/10	Co-57	0.01 ± 0.03	0.00	-	Pass
STVE-1199	03/01/10	Co-60	3.39 ± 0.12	3.27	2.29 - 4.25	Pass
STVE-1199	03/01/10	Cs-134	4.74 ± 0.15	4.39	3.07 - 5.71	Pass
STVE-1199	03/01/10	Cs-137	3.32 ± 0.17	3.06	2.14 - 3.98	Pass
STVE-1199	03/01/10	Mn-54	0.01 ± 0.05	0.00	-	Pass
STVE-1199	03/01/10	Zn-65	8.03 ± 0.33	7.10	4.97 - 9.23	Pass
STW-1200	03/01/10	Gr. Alpha	0.40 ± 0.05	0.68	0.00 - 1.35	Pass
STW-1200	03/01/10	Gr. Beta	3.03 ± 0.07	3.09	1.55 - 4.64	Pass
STW-1201	03/01/10	Co-57	28.90 ± 0.40	28.30	19.80 - 36.80	Pass
STW-1201	03/01/10	Co-60	0.06 ± 0.05	0.00	-	Pass
STW-1201	03/01/10	Cs-134	-0.03 ± 0.09	0.00	-	Pass
STW-1201	03/01/10	Cs-137	60.60 ± 0.60	60.60	42.40 - 78.80	Pass
STW-1201	03/01/10	H-3	93.20 ± 18.30	90.80	63.60 - 118.00	Pass
STW-1201	03/01/10	Mn-54	27.80 ± 0.40	26.90	18.80 - 35.00	Pass
STW-1201	03/01/10	Sr-90	-0.10 ± 0.60	0.00	-	Pass
STW-1201	03/01/10	Zn-65	42.70 ± 0.80	40.70	28.50 - 52.90	Pass
STSO-1202	03/01/10	Co-57	520.00 ± 10.80	522.00	365.00 - 679.00	Pass
STSO-1202	03/01/10	Co-60	599.10 ± 2.80	622.00	435.00 - 809.00	Pass
STSO-1202	03/01/10	Cs-134	666.10 ± 4.70	733.00	513.00 - 953.00	Pass
STSO-1202	03/01/10	Cs-137	774.40 ± 4.50	779.00	545.00 - 1013.00	Pass
STSO-1202	03/01/10	K-40	562.00 ± 15.30	559.00	391.00 - 727.00	Pass
STSO-1202	03/01/10	Mn-54	866.20 ± 4.60	849.00	594.00 - 1104.00	Pass
STSO-1202	03/01/10	Sr-90	225.50 ± 11.80	288.00	202.00 - 374.00	Pass
STSO-1202	03/01/10	Zn-65	-1.23 ± 1.96	0.00	-	Pass
STAP-1203	03/01/10	Co-57	0.01 ± 0.02	0.00	-	Pass
STAP-1203	03/01/10	Co-60	2.63 ± 0.19	2.47	1.73 - 3.22	Pass
STAP-1203	03/01/10	Cs-134	2.21 ± 0.34	2.13	1.49 - 2.77	Pass
STAP-1203	03/01/10	Cs-137	1.66 ± 0.22	1.53	1.07 - 1.99	Pass
STAP-1203	03/01/10	Mn-54	3.42 ± 0.26	3.02	2.11 - 3.93	Pass
STAP-1203	03/01/10	Sr-90	0.02 ± 0.06	0.00	-	Pass
STAP-1203	03/01/10	Zn-65	-0.05 ± 0.11	0.00	-	Pass
STAP-1204	03/01/10	Gr. Alpha	0.13 ± 0.03	0.43	0.00 - 0.85	Pass
STAP-1204	03/01/10	Gr. Beta	1.46 ± 0.07	1.29	0.65 - 1.94	Pass

TABLE D-5

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)^a
ENVIRONMENTAL, INC., 2010

(Page 2 of 3)

Lab Code ^c	Date	Analysis	Laboratory result	Concentration ^b		Acceptance
				Known Activity	Control Limits ^d	
STW-1211	08/01/10	Co-57	36.40 ± 4.80	36.00	25.20 - 46.80	Pass
STW-1211	08/01/10	Co-60	28.30 ± 1.00	28.30	19.80 - 36.80	Pass
STW-1211	08/01/10	Cs-134	29.30 ± 2.10	31.40	22.00 - 40.80	Pass
STW-1211	08/01/10	Cs-137	44.60 ± 1.80	44.20	30.90 - 57.50	Pass
STW-1211	08/01/10	H-3	503.60 ± 12.80	453.40	317.40 - 589.40	Pass
STW-1211	08/01/10	K-40	38.50 ± 2.50	38.90	27.20 - 50.60	Pass
STW-1211	08/01/10	Mn-54	0.10 ± 0.30	0.00	-	Pass
STW-1211	08/01/10	Sr-90	9.20 ± 1.30	8.30	5.80 - 10.80	Pass
STW-1211	08/01/10	Zn-65	32.80 ± 3.00	31.00	21.70 - 40.30	Pass
STW-1212	08/01/10	Gr. Alpha	1.54 ± 0.09	1.92	0.58 - 3.26	Pass
STW-1212	08/01/10	Gr. Beta	4.13 ± 0.15	4.39	2.20 - 6.59	Pass
STVE-1213	08/01/10	Co-57	9.60 ± 0.54	8.27	5.79 - 10.75	Pass
STVE-1213	08/01/10	Co-60	0.05 ± 0.08	0.00	-	Pass
STVE-1213	08/01/10	Cs-134	4.83 ± 0.26	4.79	3.35 - 6.23	Pass
STVE-1213	08/01/10	Cs-137	6.45 ± 0.66	5.88	4.12 - 7.64	Pass
STVE-1213	08/01/10	Mn-54	7.12 ± 0.66	6.29	4.40 - 8.17	Pass
STVE-1213	08/01/10	Zn-65	6.05 ± 0.74	5.39	3.77 - 7.01	Pass
STSO-1214	08/01/10	Co-57	0.10 ± 1.60	0.00	-	Pass
STSO-1214	08/01/10	Co-60	370.00 ± 6.00	343.00	240.00 - 446.00	Pass
STSO-1214	08/01/10	Cs-134	1005.00 ± 21.00	940.00	658.00 - 1222.00	Pass
STSO-1214	08/01/10	Cs-137	755.00 ± 15.00	670.00	469.00 - 871.00	Pass
STSO-1214	08/01/10	K-40	783.00 ± 54.00	699.00	489.00 - 909.00	Pass
STSO-1214	08/01/10	Mn-54	942.00 ± 15.00	820.00	574.00 - 1066.00	Pass
STSO-1214	08/01/10	Sr-90	3.50 ± 8.00	0.00	-	Pass
STSO-1214	08/01/10	Zn-65	310.00 ± 18.00	265.00	186.00 - 345.00	Pass
STAP-1215	08/01/10	Co-57	4.47 ± 0.21	4.08	2.86 - 5.30	Pass
STAP-1215	08/01/10	Co-60	3.15 ± 0.30	2.92	2.04 - 3.80	Pass
STAP-1215	08/01/10	Cs-134	3.03 ± 0.17	2.98	2.09 - 3.87	Pass
STAP-1215	08/01/10	Cs-137	0.01 ± 0.05	0.00	-	Pass
STAP-1215	08/01/10	Mn-54	3.69 ± 0.39	3.18	2.23 - 4.13	Pass
STAP-1215	08/01/10	Sr-90	1.00 ± 0.12	1.01	0.71 - 1.31	Pass
STAP-1215	08/01/10	Zn-65	0.03 ± 0.15	0.00	-	Pass

TABLE D-5

DOE'S MIXED ANALYTE PERFORMANCE EVALUATION PROGRAM (MAPEP)^a
ENVIRONMENTAL, INC., 2010

(Page 3 of 3)

Lab Code ^c	Date	Analysis	Laboratory result	Concentration ^b		Acceptance
				Known Activity	Control Limits ^d	
STAP-1216	08/01/10	Gr. Alpha	0.01 ± 0.01	0.00	-	Pass
STAP-1216	08/01/10	Gr. Beta	0.54 ± 0.05	0.50	0.25 - 0.75	Pass

^a Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the Department of Energy's Mixed Analyte Performance Evaluation Program, Idaho Operations office, Idaho Falls, Idaho

^b Results are reported in units of Bq/kg (soil), Bq/L (water) or Bq/total sample (filters, vegetation).

^c Laboratory codes as follows: STW (water), STAP (air filter), STSO (soil), STVE (vegetation).

^d MAPEP results are presented as the known values and expected laboratory precision (1 sigma, 1 determination) and control limits as defined by the MAPEP.

^e Included in the testing series as a "false positive".

APPENDIX E

EFFLUENT DATA

TABLE OF CONTENTS

INTRODUCTION	1
SUMMARY.....	2
1.0. EFFLUENTS.....	3
1.1. Gaseous Effluents to the Atmosphere	3
1.2. Liquids Released to Lake Michigan.....	3
2.0. SOLID RADIOACTIVE WASTE	3
3.0. DOSE TO MAN.....	3
3.1. Gaseous Effluent Pathways	3
3.1.1. Gaseous Releases	4
3.1.1.1. Gamma Dose Rates.....	4
3.1.1.2. Beta Air and Skin Dose Rate	4
3.1.2. Radioactive Iodine	5
3.1.3. Dose to Thyroid	5
3.2. Liquid Effluent Pathways	5
3.3. Assessment of Dose to Member of Public	5
4.0. SITE METEOROLOGY	6

Table of Contents (cont.)

APPENDIX E-1 DATA TABLES AND FIGURES..... E-1.1

Station Releases

Table 2.0-1 Solid Radioactive Waste..... E-1.2
Table 3.1-1 Maximum Doses Resulting from Airborne Releases E-1.3
Table 3.2-1 Maximum Doses Resulting from Liquid Effluents E-1.5
Table 3.3-1 10CFR20 Compliance Assessment..... E-1.6
Table 3.4-1 Maximum doses Resulting from Airborne Releases Based
On Concurrent Meteorological Data E-1.7

INTRODUCTION

Units 1 and 2 of the Zion Station, located in Zion, Illinois adjacent to Lake Michigan, are 1100 MWe (3520 MWt) Westinghouse pressurized water reactors. The plant permanently ceased operation in February of 1998 and has been permanently defueled.

The station was designed to keep releases to the environment at levels below those specified in the regulations. Historical data has been established that Zion, as a fully operational facility, did not contribute appreciable doses to the surrounding public. Sampling results for 2010 showed minimal releases above background for a variety of monitored pathways, e.g. water, vegetation, air samples and TLIV.

Liquid effluents from Zion Station are released to Lake Michigan in controlled batches after radioassay of each batch and continuously through a monitored pathway. There are no routine noble gas releases. Due to decay, iodine is no longer present. The only noble gas that remains is Kr85 captured in the spent fuel assemblies stored in the fuel pool in the fuel building. The results of effluent analyses are summarized on a monthly basis and reported to the Nuclear Regulatory Commission as required per Technical Specifications. Airborne concentrations of noble gases and particulate radioactivity in offsite areas are calculated using effluent and meteorological data.

Environmental monitoring was conducted by sampling at indicator and control (background) locations in the vicinity of the Zion Station to measure changes in radiation or radioactivity levels that may be attributable to the station. If significant changes attributable to Zion Station are measured, these changes are correlated with effluent releases.

SUMMARY

Gaseous and liquid effluents for the period contributed to only a small fraction of the Station Technical Specification limits. Calculations of environmental concentrations based on effluent and meteorological data for the period indicate that consumption by the public of radionuclides attributable to the Zion Station does not exceed regulatory limits. Radiation exposure from radionuclides released to the atmosphere represented the critical pathway for the period with a maximum individual total body dose estimated to be $1.29\text{E-}04$ mrem for the year, where a shielding and occupancy factor of 0.7 is assumed. The assessment of radiation doses is performed in accordance with the Zion Station Offsite Dose Calculation Manual (ODCM). The results of analysis confirm that the station is operating in compliance with 10CFR50 Appendix 1, 10CFR20 and 40CFR190.

1.0 EFFLUENTS

1.1 Gaseous Effluents to the Atmosphere

Measured concentrations and isotopic composition of noble gases and particulate radioactivity released to the atmosphere were monitored during the year. A total of 0.00E+00 microcuries of fission and activation gases was released with a maximum average release rate of 0.00E+00 $\mu\text{Ci}/\text{sec}$ during any one quarter period.

A total of 0.00E+00 microcuries of beta-gamma emitters was released as airborne particulate matter with a maximum average quarterly release rate of 0.00E+00 $\mu\text{Ci}/\text{sec}$. quarterly only. Alpha-emitting radionuclides were not measurable. Also, 5.08E-02 curies of tritium were released with a maximum average quarterly release rate of 8.35E-04 $\mu\text{Ci}/\text{sec}$.

1.2 Liquids Released to Lake Michigan

A total of 2.74E+07 liters of liquid waste containing 0.00E+00 microcuries was discharged from the station via an approved pathway after dilution with a total of 4.37E+10 liters of water. These wastes were released at a maximum quarterly average concentration of 0.00E+00 $\mu\text{Ci}/\text{ml}$. A total of 0.00E-00 curies of tritium was released. Alpha activity released totaled 0.00 μCi for the year. Monthly release estimates and principal radionuclides in liquid effluents are reported in the Zion Nuclear Power Station Radioactive Effluent Report for 2010.

2.0 SOLID RADIOACTIVE WASTE

There were NO solid radioactive waste shipment in 2010.

3.0 DOSE TO MAN

3.1 Gaseous Effluent Pathways

Table 3.1-1 summarizes the doses resulting from releases of airborne radioactivity via the different exposure pathways.

3.1.1 Gaseous Releases

3.1.1.1 Gamma Dose Rates

Offsite Gamma air and whole (total) body dose rates are shown in Table 3.1-1 and were calculated based on measured release rates, isotopic composition of the gases, and meteorological data for the period. Based on measured effluents and average meteorological data, the maximum total body dose to an individual would be 1.29 E-04 mrem (child) for the year (Table 3.1-1), with an occupancy or shielding factor of 0.7 included, and based on measured effluents and concurrent meteorological data would be 0.00E+00 mrem (Table 3.4-1). The maximum gamma air dose was 0.00E+00 mrad based on measured effluents and average meteorological data (Table 3.1-1), and 0.00E+00 mrad based on measured effluents and concurrent meteorological data (Table 3.4-1).

3.1.1.2 Beta Air and Skin Dose Rates

The range of beta particles in air is relatively small (on the order of a few meters or less); consequently, plumes of gaseous effluents may be considered "infinite" for purpose of calculating the dose from beta radiation incident on the skin. However, the actual dose to sensitive skin tissues is difficult to calculate due to the effect of the beta particle energies, thickness of inert skin and clothing covering sensitive tissues. For purposes of this report the skin is taken to have a thickness of 7.0 mg/cm² and an occupancy factor of 1.0 is used. The skin dose from beta and gamma radiation for the year was 0.00E+00 mrem based on measured effluents and average meteorological data (Table 3.1-1), and 0.00E+00 mrem based on measured effluents and concurrent meteorological data (Table 3.4-1).

The maximum offsite beta air dose for the year was 0.00E+00 mrad based on measured effluents and average meteorological data (Table 3.1-1), and 0.00E+00 mrad based on measured effluents and concurrent meteorological data (Table 3.4-1).

3.1.2 Radioactive Iodine

The human thyroid exhibits a significant capacity to concentrate ingested or inhaled iodine. The radioiodine, I-131, released during routine operation of the station, may be made available to man resulting in a dose to the thyroid. The principal pathway of interest for this radionuclide is ingestion of radioiodine in milk. As Zion Station is not operational and I-131 has decayed away, the maximum offsite concentration is estimated to be zero, as expected.

3.1.3 Dose to Thyroid

The hypothetical thyroid dose to a maximum exposed individual living near the station via ingestion of milk was calculated. As Zion Station is not operational and I-131 has decayed away, the maximum offsite concentration is estimated to be zero, as expected.

3.2 Liquid Effluent Pathways

The three principal pathways through the aquatic environment for potential doses to man from liquid waste are ingestion of potable water, eating aquatic foods, and exposure while on the shoreline. Not all of these pathways are significant or applicable at a given time but a reasonable approximation of the dose can be made by adjusting the dose formula for season of the year or type and degree of use of the aquatic environment. NRC developed equations* were used to calculate the doses to the whole body, lower GI tracts, thyroid, bone, skin; specific parameters for use in the equations are given in the Zion Station Offsite Dose Calculation Manual. The maximum whole body dose (total body) for the year was 0.00E+00 mrem and no organ dose exceeded 0.00E+00 mrem (Table 3.2-1).

3.3 Assessment of Dose to Member of Public

During the period January to December, 2010, Zion Station did not

exceed the below limits as shown in Table 3.1-1 and Table 3.2-1 (based on yearly average meteorological data), and Figure 3.1-1 (based on concurrent meteorological data):

- The RETS limits on dose or dose commitment to an individual due to radioactive materials in liquid effluents from each reactor unit (3 mrem to the whole body or 10 mrem to any organ during any calendar year).
- The RETS limits on air dose in noble gases released in gaseous effluents to a member of the public from each reactor unit (10 mrad for gamma radiation or 20 mrad for beta radiation during any calendar year).
- The RETS limits on dose to a member of the public due to iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than eight days in gaseous effluents released from each reactor unit (15 mrem to any organ during any calendar year).
- The 10CFR20 limit on Total Effective Dose Equivalent to individual members of the public (100 mrem).

4.0 SITE METEOROLOGY

A summary of the site meteorological measurements taken during each calendar quarter of the year is given in Appendix 11. The data are presented as cumulative joint frequency

*Nuclear Regulatory Commission, Regulatory Guide 1.109 (Rev. 1) distributions of the wind direction for the 250' level and wind speed class by atmospheric stability class determined from the temperature difference between the 250' and 35' levels. Data recovery for these measurements was 99.7% during 2010 (Table 3.4-1).

APPENDIX E-1

DATA TABLES AND FIGURES

Table 2.0-1
Solid Radioactive Waste

Table 2.0-1 has been deliberately deleted. For details on solid waste disposal, see the Zion 2010 Annual Effluent Report

Table 3.1-1
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

=== I&P DOSE LIMIT ANALYSIS =====				QUARTER 1 =====	
Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
Qtr 1 - Admin. Any Organ	CHILD	LIVER	3.21E-05	5.63E+00	5.71E-04
Qtr 1 - Admin. Total Body	CHILD	TBODY	3.21E-05	5.25E+00	6.12E-04
Qtr 1 - T.Spc. Any Organ	CHILD	LIVER	3.21E-05	7.50E+00	4.28E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				
Qtr 1 - T.Spc. Total Body	CHILD	TBODY	3.21E-05	7.50E+00	4.28E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

GASEOUS DOSE SUMMARY

Report for: 2010
Unit Range - From: 1 To: 2

Quarter - Limit	Dose (mrad)	Limit (mrad)	Max % of Limit
==== NG DOSE LIMIT ANALYSIS ===== QUARTER 1 =====			
-----	-----	-----	-----
Qtr 1 - Admin. Gamma	0.00E+00	7.50E+00	0.00E+00
Qtr 1 - Admin. Beta	0.00E+00	7.50E+00	0.00E+00
Qtr 1 - T.Spc. Gamma	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		
Qtr 1 - T.Spc. Beta	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

=== I&P DOSE LIMIT ANALYSIS =====				QUARTER 2 =====	
Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
-----	-----	-----	-----	-----	-----
Qtr 2 - Admin. Any Organ	CHILD	LIVER	3.25E-05	5.63E+00	5.78E-04
Qtr 2 - Admin. Total Body	CHILD	TBODY	3.25E-05	5.25E+00	6.19E-04
Qtr 2 - T.Spc. Any Organ	CHILD	LIVER	3.25E-05	7.50E+00	4.33E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				
Qtr 2 - T.Spc. Total Body	CHILD	TBODY	3.25E-05	7.50E+00	4.33E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

Quarter - Limit	Dose (mrad)	Limit (mrad)	Max % of Limit
==== NG DOSE LIMIT ANALYSIS ===== QUARTER 2 =====			
-----	-----	-----	-----
Qtr 2 - Admin. Gamma	0.00E+00	7.50E+00	0.00E+00
Qtr 2 - Admin. Beta	0.00E+00	7.50E+00	0.00E+00
Qtr 2 - T.Spc. Gamma	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		
Qtr 2 - T.Spc. Beta	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

=== I&P DOSE LIMIT ANALYSIS ===== QUARTER 3 =====

Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
Qtr 3 - Admin. Any Organ	CHILD	LIVER	3.23E-05	5.63E+00	5.74E-04
Qtr 3 - Admin. Total Body	CHILD	TBODY	3.23E-05	5.25E+00	6.15E-04

Qtr 3 - T.Spc. Any Organ CHILD LIVER 3.23E-05 7.50E+00 4.31E-04
 Receptor: 5 Composite Crit. Receptor - IP
 Distance: 0.00 (meters) Compass Point: NA
 Critical Pathway: Vegetation (VEG)
 Major Contributors (0% or greater to total)
 Nuclide Percentage

 H-3 1.00E+02

Qtr 3 - T.Spc. Total Body CHILD TBODY 3.23E-05 7.50E+00 4.31E-04
 Receptor: 5 Composite Crit. Receptor - IP
 Distance: 0.00 (meters) Compass Point: NA
 Critical Pathway: Vegetation (VEG)
 Major Contributors (0% or greater to total)
 Nuclide Percentage

 H-3 1.00E+02

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

GASEOUS DOSE SUMMARY

Report for: 2010
Unit Range - From: 1 To: 2

Quarter - Limit	Dose (mrad)	Limit (mrad)	Max % of Limit
==== NG DOSE LIMIT ANALYSIS ===== QUARTER 3 =====			
-----	-----	-----	-----
Qtr 3 - Admin. Gamma	0.00E+00	7.50E+00	0.00E+00
Qtr 3 - Admin. Beta	0.00E+00	7.50E+00	0.00E+00
Qtr 3 - T.Spc. Gamma	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		
Qtr 3 - T.Spc. Beta	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

=== I&P DOSE LIMIT ANALYSIS =====				QUARTER 4	=====
Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
-----	-----	-----	-----	-----	-----
Qtr 4 - Admin. Any Organ	CHILD	LIVER	3.23E-05	5.63E+00	5.74E-04
Qtr 4 - Admin. Total Body	CHILD	TBODY	3.23E-05	5.25E+00	6.15E-04
Qtr 4 - T.Spc. Any Organ	CHILD	LIVER	3.23E-05	7.50E+00	4.31E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				
Qtr 4 - T.Spc. Total Body	CHILD	TBODY	3.23E-05	7.50E+00	4.31E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

Quarter - Limit	Dose (mrad)	Limit (mrad)	Max % of Limit
=== NG DOSE LIMIT ANALYSIS ===== QUARTER 4 =====			
-----	-----	-----	-----
Qtr 4 - Admin. Gamma	0.00E+00	7.50E+00	0.00E+00
Qtr 4 - Admin. Beta	0.00E+00	7.50E+00	0.00E+00
Qtr 4 - T.Spc. Gamma	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		
Qtr 4 - T.Spc. Beta	0.00E+00	7.50E+00	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

=== I&P DOSE LIMIT ANALYSIS =====			ANNUAL 2010 =====		
Annual - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
-----	-----	-----	-----	-----	-----
2010 - Admin. Any Organ	CHILD	LIVER	1.29E-04	1.13E+01	1.15E-03
2010 - Admin. Total Body	CHILD	TBODY	1.29E-04	1.05E+01	1.23E-03
2010 - T.Spc. Any Organ	CHILD	LIVER	1.29E-04	1.50E+01	8.62E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				
2010 - T.Spc. Total Body	CHILD	TBODY	1.29E-04	1.50E+01	8.62E-04
Receptor: 5 Composite Crit. Receptor - IP					
Distance: 0.00 (meters) Compass Point: NA					
Critical Pathway: Vegetation (VEG)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
H-3	1.00E+02				

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

 GASEOUS DOSE SUMMARY

Report for: 2010
 Unit Range - From: 1 To: 2

Annual - Limit	Dose (mrad)	Limit (mrad)	Max % of Limit

2010 - Admin. Gamma	0.00E+00	1.50E+01	0.00E+00
2010 - Admin. Beta	0.00E+00	1.50E+01	0.00E+00
2010 - T.Spc. Gamma	0.00E+00	1.50E+01	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		
2010 - T.Spc. Beta	0.00E+00	1.50E+01	0.00E+00
Receptor: 5 Composite Crit. Receptor - IP			
Distance: 0.00 (meters) Compass Point: NA			
Nuclide	Percentage		
-----	-----		

Table 3.1-1 (continued)
Maximum Doses Resulting from Airborne Releases

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

Report for: 2010
 Unit Range - From: 1 To: 2

=== MAXIMUM DOSE ANALYSIS ===== ANNUAL 2010 =====

Dose Type	Age Group	Organ	Dose (mrem)

Any Organ	CHILD	LIVER	1.29E-04
Liquid Receptor:	NA		
Gaseous Receptor:	5 Composite Crit. Receptor - IP		
Distance:	0.00 (meters) Compass Point: NA		
Liquid Dose:	0.00E+00	% of Total:	0.00E+00
Critical Pathway:	Potable Water (PWtr)		
Major Contributors (0% or greater to total)			
Nuclide	Percentage		
-----	-----		
Gaseous Dose:	1.29E-04	% of Total:	1.00E+02
Critical Pathway:	Vegetation (VEG)		
Major Contributors (0% or greater to total)			
Nuclide	Percentage		
-----	-----		
H-3	1.00E+02		

=== MAXIMUM DOSE ANALYSIS ===== ANNUAL 2010 =====

Dose Type	Age Group	Organ	Dose (mrem)

Total Body	CHILD	TBODY	1.29E-04
Liquid Receptor:	NA		
Gaseous Receptor:	5 Composite Crit. Receptor - IP		
Distance:	0.00 (meters) Compass Point: NA		
Liquid Dose:	0.00E+00	% of Total:	0.00E+00
Critical Pathway:	Potable Water (PWtr)		
Major Contributors (0% or greater to total)			
Nuclide	Percentage		
-----	-----		
Gaseous Dose:	1.29E-04	% of Total:	1.00E+02
Critical Pathway:	Vegetation (VEG)		
Major Contributors (0% or greater to total)			
Nuclide	Percentage		
-----	-----		
H-3	1.00E+02		

Table 3.2-1
Maximum Doses Resulting from Liquid Effluents

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

LIQUID DOSE SUMMARY

Report for: 2010
Unit Range - From: 1 To: 2

Liquid Receptor

=== PERIOD DOSE BY ORGAN AND AGE GROUP (mrem) ===== QUARTER 1 =====
Agegrp Bone Liver Thyroid Kidney Lung GI-LLI Skin TB

=== SITE DOSE LIMIT ANALYSIS ===== QUARTER 1=====

Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
Qtr 1 - Admin. Any Organ			0.00E+00	0.00E+00	0.00E+00
Qtr 1 - Admin. Total Body	ADULT	TBODY	0.00E+00	1.13E+00	0.00E+00

Qtr 1 - T.Spc. Any Organ 0.00E+00 3.75E+00 0.00E+00

Critical Pathway:
Major Contributors (0% or greater to total)
Nuclide Percentage

Qtr 1 - T.Spc. Total Body	ADULT	TBODY	0.00E+00	1.50E+00	0.00E+00
---------------------------	-------	-------	----------	----------	----------

Critical Pathway: Potable Water (PWtr)
Major Contributors (0% or greater to total)
Nuclide Percentage

Table 3.2-1 (continued)
Maximum Doses Resulting from Liquid Effluents

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

LIQUID DOSE SUMMARY

Report for: 2010
Unit Range - From: 1 To: 2

Liquid Receptor

=== PERIOD DOSE BY ORGAN AND AGE GROUP (mrem) ===== QUARTER 3 =====

Agegrp	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	Skin	TB
--------	------	-------	---------	--------	------	--------	------	----

=== SITE DOSE LIMIT ANALYSIS ===== QUARTER 3 =====

Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
Qtr 3 - Admin. Any Organ			0.00E+00	5.00E+00	0.00E+00
Qtr 3 - Admin. Total Body	ADULT	TBODY	0.00E+00	1.13E+00	0.00E+00
Qtr 3 - T.Spc. Any Organ			0.00E+00	3.75E+00	0.00E+00
Critical Pathway:					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
Qtr 3 - T.Spc. Total Body	ADULT	TBODY	0.00E+00	1.50E+00	0.00E+00
Critical Pathway: Potable Water (PWtr)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				

Table 3.2-1 (continued)
Maximum Doses Resulting from Liquid Effluents

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

LIQUID DOSE SUMMARY

Report for: 2010
Unit Range - From: 1 To: 2

Liquid Receptor

=== PERIOD DOSE BY ORGAN AND AGE GROUP (mrem) ===== QUARTER 4 =====

Agegrp	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	Skin	TB
-----	-----	-----	-----	-----	-----	-----	-----	-----

=== SITE DOSE LIMIT ANALYSIS ===== QUARTER 4 =====

Quarter - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
-----	-----	-----	-----	-----	-----
Qtr 4 - Admin. Any Organ			0.00E+00	5.00E+00	0.00E+00
Qtr 4 - Admin. Total Body	ADULT	TBODY	0.00E+00	1.13E+00	0.00E+00
Qtr 4 - T.Spc. Any Organ			0.00E+00	3.75E+00	0.00E+00
Critical Pathway:					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
Qtr 4 - T.Spc. Total Body	ADULT	TBODY	0.00E+00	1.50E+00	0.00E+00
Critical Pathway: Potable Water (PWtr)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				

Table 3.2-1 (continued)
Maximum Doses Resulting from Liquid Effluents

40CFR190 URANIUM FUEL CYCLE DOSE REPORT

LIQUID DOSE SUMMARY

Report for: 2010
Unit Range - From: 1 To: 2

Liquid Receptor

=== PERIOD DOSE BY ORGAN AND AGE GROUP(mrem) ===== ANNUAL 2010 =====

Agegrp	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI	Skin	TB
--------	------	-------	---------	--------	------	--------	------	----

=== SITE DOSE LIMIT ANALYSIS ===== ANNUAL 2010 =====

Annual - Limit	Age Group	Organ	Dose (mrem)	Limit (mrem)	Max % of Limit
2010 - Admin. Any Organ			0.00E+00	5.00E+00	0.00E+00
2010 - Admin. Total Body	ADULT	TBODY	0.00E+00	2.25E+00	0.00E+00
2010 - T.Spc. Any Organ			0.00E+00	7.50E+00	0.00E+00
Critical Pathway:					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				
2010 - T.Spc. Total Body	ADULT	TBODY	0.00E+00	3.00E+00	0.00E+00
Critical Pathway: Potable Water (PWtr)					
Major Contributors (0% or greater to total)					
Nuclide	Percentage				
-----	-----				

APPENDIX F

METEOROLOGICAL DATA

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	1	5	3	0	11
NNE	0	5	11	3	1	0	20
NE	0	5	7	1	0	0	13
ENE	0	2	4	0	0	0	6
E	0	6	0	0	0	0	6
ESE	0	3	3	0	0	0	6
SE	0	4	3	0	0	0	7
SSE	0	0	1	0	0	0	1
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	1	0	0	0	0	1
WSW	0	3	1	0	0	0	4
W	0	2	3	0	0	0	5
WNW	0	5	5	0	0	0	10
NW	1	2	10	0	0	0	13
NNW	0	2	0	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	1	42	49	9	4	0	105

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	3	5	1	0	9
NNE	0	4	3	1	3	0	11
NE	0	1	0	1	0	0	2
ENE	0	1	1	0	0	0	2
E	2	3	1	0	0	0	6
ESE	0	2	1	0	0	0	3
SE	0	1	0	0	0	0	1
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	2	0	0	0	0	2
WSW	0	1	0	0	0	0	1
W	0	2	0	0	0	0	2
WNW	0	2	2	0	0	0	4
NW	0	2	10	0	0	0	12
NNW	0	1	1	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	2	22	22	7	4	0	57

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	6	4	1	0	11
NNE	0	4	7	2	1	0	14
NE	0	1	1	2	0	0	4
ENE	1	3	0	0	0	0	4
E	0	3	0	0	0	0	3
ESE	0	3	1	0	0	0	4
SE	0	3	0	0	0	0	3
SSE	0	1	6	1	0	0	8
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	1	0	0	0	0	1
WSW	0	1	1	0	0	0	2
W	0	4	2	0	0	0	6
WNW	0	4	3	0	0	0	7
NW	0	2	12	0	0	0	14
NNW	0	2	5	0	0	0	7
Variable	0	0	0	0	0	0	0
Total	1	32	44	9	2	0	88

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	14	61	29	4	0	109
NNE	2	16	23	42	1	0	84
NE	0	4	21	19	0	0	44
ENE	1	8	14	7	0	0	30
E	2	14	7	6	1	0	30
ESE	5	18	7	8	0	0	38
SE	6	13	0	0	0	0	19
SSE	4	18	11	4	1	0	38
S	1	7	0	0	0	0	8
SSW	2	1	2	0	0	0	5
SW	3	6	30	5	0	0	44
WSW	11	27	28	6	0	0	72
W	5	30	16	7	0	0	58
WNW	1	45	31	2	0	0	79
NW	1	38	80	5	0	0	124
NNW	1	22	27	0	0	0	50
Variable	0	0	0	0	0	0	0
Total	46	281	358	140	7	0	832

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	16	20	13	0	0	49
NNE	6	12	16	1	0	0	35
NE	1	5	15	10	0	0	31
ENE	0	3	3	7	0	0	13
E	2	0	3	13	6	0	24
ESE	5	9	4	3	0	0	21
SE	4	13	9	1	0	0	27
SSE	6	16	15	5	1	0	43
S	7	10	5	0	0	0	22
SSW	11	10	12	2	0	0	35
SW	10	15	24	1	0	0	50
WSW	7	20	24	2	0	0	53
W	12	61	14	4	0	0	91
WNW	11	70	35	1	0	0	117
NW	10	63	54	5	0	0	132
NNW	1	18	28	3	0	0	50
Variable	0	0	0	0	0	0	0
Total	93	341	281	71	7	0	793

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 17
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	3	0	0	0	0	4
NNE	0	2	0	0	0	0	2
NE	1	0	0	0	0	0	1
ENE	1	0	0	0	0	0	1
E	2	3	0	0	0	0	5
ESE	2	7	2	0	0	0	11
SE	1	4	2	0	0	0	7
SSE	1	0	1	2	0	0	4
S	1	3	7	0	0	0	11
SSW	5	0	0	0	0	0	5
SW	4	2	0	0	0	0	6
WSW	3	1	1	0	0	0	5
W	8	20	0	0	0	0	28
WNW	12	18	0	0	0	0	30
NW	9	20	1	0	0	0	30
NNW	2	2	0	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	53	85	14	2	0	0	154

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	5	0	0	0	0	0	5
NNE	2	0	0	0	0	0	2
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	1	3	0	0	0	0	4
SE	1	1	0	0	0	0	2
SSE	0	3	7	1	0	0	11
S	1	4	5	0	0	0	10
SSW	3	0	0	0	0	0	3
SW	5	2	0	0	0	0	7
WSW	2	1	0	0	0	0	3
W	10	9	0	0	0	0	19
WNW	7	11	0	0	0	0	18
NW	2	2	0	0	0	0	4
NNW	2	0	0	0	0	0	2
Variable	0	0	0	0	0	0	0
Total	41	36	12	1	0	0	90

Hours of calm in this stability class: 2
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	3	1	1	2	5	12
NNE	0	0	10	6	2	2	20
NE	0	4	6	2	1	0	13
ENE	0	0	3	1	0	0	4
E	0	3	1	0	0	0	4
ESE	0	3	1	0	0	0	4
SE	0	6	2	4	0	0	12
SSE	0	1	0	0	0	0	1
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	1	0	2	0	0	3
W	0	2	3	0	0	0	5
WNW	0	1	6	2	0	0	9
NW	0	5	5	7	0	0	17
NNW	0	1	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	0	30	38	25	5	7	105

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	0	1	3	3	7
NNE	0	1	3	5	1	3	13
NE	0	1	0	1	0	0	2
ENE	0	1	0	1	0	0	2
E	0	3	0	1	0	0	4
ESE	1	1	1	0	0	0	3
SE	0	1	1	0	0	0	2
SSE	0	0	0	0	0	0	0
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	1	0	0	0	1
W	0	1	2	0	0	0	3
WNW	0	1	2	0	0	0	3
NW	0	0	2	10	1	0	13
NNW	0	1	1	2	0	0	4
Variable	0	0	0	0	0	0	0
Total	1	11	13	21	5	6	57

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	3	2	1	4	11
NNE	0	1	1	8	1	2	13
NE	0	2	1	2	2	0	7
ENE	0	0	0	0	0	0	0
E	0	5	0	0	0	0	5
ESE	0	0	0	0	0	0	0
SE	0	2	4	2	0	0	8
SSE	0	0	3	4	0	0	7
S	0	0	0	0	0	0	0
SSW	0	0	0	0	0	0	0
SW	0	0	0	0	0	0	0
WSW	0	0	2	1	0	0	3
W	0	2	2	2	0	0	6
WNW	0	0	1	1	0	0	2
NW	0	0	5	13	0	0	18
NNW	0	0	3	5	0	0	8
Variable	0	0	0	0	0	0	0
Total	0	13	25	40	4	6	88

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	17	34	23	12	87
NNE	1	4	8	32	26	29	100
NE	1	4	5	16	15	10	51
ENE	0	8	5	8	9	0	30
E	1	9	8	8	6	0	32
ESE	0	7	5	8	14	0	34
SE	2	13	7	1	0	0	23
SSE	1	10	17	2	5	0	35
S	0	4	7	2	0	0	13
SSW	1	3	0	1	0	0	5
SW	1	6	1	16	2	0	26
WSW	2	12	16	34	12	1	77
W	1	11	21	11	11	2	57
WNW	1	8	21	21	5	0	56
NW	0	1	39	78	18	1	137
NNW	0	2	29	32	6	0	69
Variable	0	0	0	0	0	0	0
Total	12	103	206	304	152	55	832

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	1	9	15	3	4	33
NNE	1	1	10	19	13	8	52
NE	0	7	5	14	9	6	41
ENE	1	3	3	7	8	0	22
E	1	2	1	2	10	4	20
ESE	0	3	2	6	3	7	21
SE	1	6	5	17	14	1	44
SSE	1	7	12	4	9	3	36
S	0	14	11	1	0	1	27
SSW	1	3	4	2	1	0	11
SW	1	7	13	30	6	0	57
WSW	3	4	10	13	6	0	36
W	2	12	43	17	16	1	91
WNW	0	4	27	38	11	0	80
NW	0	5	39	95	19	0	158
NNW	1	2	23	47	10	0	83
Variable	0	0	0	0	0	0	0
Total	14	81	217	327	138	35	812

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	5	15	0	0	21
NNE	0	2	2	1	0	0	5
NE	0	5	0	1	0	0	6
ENE	0	3	0	1	0	0	4
E	0	1	2	0	0	0	3
ESE	0	2	0	0	6	3	11
SE	1	2	1	1	4	3	12
SSE	1	0	4	3	2	1	11
S	0	2	2	1	4	0	9
SSW	1	4	1	2	2	0	10
SW	2	0	1	1	0	0	4
WSW	1	0	0	0	0	0	1
W	0	3	0	2	3	0	8
WNW	0	3	4	12	4	0	23
NW	1	1	2	8	0	0	12
NNW	0	4	5	6	1	0	16
Variable	0	0	0	0	0	0	0
Total	7	33	29	54	26	7	156

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: January - March 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	4	2	0	0	6
NNE	2	2	1	0	0	0	5
NE	0	2	0	0	0	0	2
ENE	0	1	0	0	0	0	1
E	0	2	0	0	0	0	2
ESE	2	2	0	2	1	2	9
SE	0	1	1	0	1	1	4
SSE	0	0	0	0	0	1	1
S	4	5	2	7	3	1	22
SSW	2	0	6	8	0	0	16
SW	1	0	1	3	1	0	6
WSW	1	0	0	0	1	0	2
W	0	0	0	0	0	0	0
WNW	0	0	1	4	2	0	7
NW	0	0	0	4	1	0	5
NNW	0	1	2	0	0	0	3
Variable	0	0	0	0	0	0	0
Total	12	16	18	30	10	5	91

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 18

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	6	9	0	0	16
NNE	0	10	45	12	0	0	67
NE	0	10	22	2	0	0	34
ENE	0	13	5	0	0	0	18
E	0	9	1	0	0	0	10
ESE	0	9	0	0	0	0	9
SE	0	5	5	0	0	0	10
SSE	0	1	1	0	0	0	2
S	0	0	0	0	0	0	0
SSW	0	0	0	6	0	0	6
SW	0	1	8	5	0	0	14
WSW	0	4	16	10	0	0	30
W	0	2	11	17	0	0	30
WNW	0	0	17	3	0	0	20
NW	0	2	11	5	0	0	18
NNW	0	1	1	3	0	0	5
Variable	0	0	0	0	0	0	0
Total	0	68	149	72	0	0	289

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	8	2	0	0	11
NNE	0	6	7	1	0	0	14
NE	0	9	0	0	0	0	9
ENE	0	0	0	0	0	0	0
E	0	4	0	0	0	0	4
ESE	0	1	1	0	0	0	2
SE	0	6	2	0	0	0	8
SSE	0	0	3	0	0	0	3
S	0	0	1	0	0	0	1
SSW	0	0	2	0	0	0	2
SW	0	0	4	2	0	0	6
WSW	0	3	1	1	0	0	5
W	0	2	1	0	0	0	3
WNW	0	1	2	1	0	0	4
NW	1	1	5	0	0	0	7
NNW	0	0	0	1	0	0	1
Variable	0	0	0	0	0	0	0
Total	1	34	37	8	0	0	80

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	4	3	0	0	8
NNE	0	11	7	0	0	0	18
NE	1	4	4	0	0	0	9
ENE	3	2	0	0	0	0	5
E	0	6	1	0	0	0	7
ESE	0	2	0	0	0	0	2
SE	0	2	0	0	0	0	2
SSE	0	7	8	0	0	0	15
S	0	1	1	0	0	0	2
SSW	0	2	0	3	0	0	5
SW	0	1	8	1	1	0	11
WSW	0	2	2	1	0	0	5
W	0	1	6	2	0	0	9
WNW	0	2	5	0	0	0	7
NW	0	1	7	1	0	0	9
NNW	1	1	0	1	0	0	3
Variable	0	0	0	0	0	0	0
Total	5	46	53	12	1	0	117

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	31	57	46	6	0	142
NNE	3	45	31	1	0	0	80
NE	8	35	7	4	0	0	54
ENE	10	13	9	3	2	0	37
E	9	16	6	7	2	0	40
ESE	9	18	5	3	3	0	38
SE	4	17	10	2	0	0	33
SSE	3	30	37	1	0	0	71
S	1	12	3	1	2	0	19
SSW	1	9	11	19	1	0	41
SW	2	8	10	6	0	0	26
WSW	1	14	22	4	0	0	41
W	0	16	23	4	0	0	43
WNW	3	18	17	3	0	0	41
NW	3	7	24	1	0	0	35
NNW	1	9	3	3	0	0	16
Variable	0	0	0	0	0	0	0
Total	60	298	275	108	16	0	757

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	15	24	11	0	0	0	50
NNE	9	18	5	0	0	0	32
NE	7	11	5	1	0	0	24
ENE	16	7	9	1	2	0	35
E	6	10	3	8	0	0	27
ESE	3	10	4	1	0	0	18
SE	5	18	2	3	2	0	30
SSE	3	28	35	8	0	0	74
S	3	34	16	2	0	0	55
SSW	8	28	9	0	0	0	45
SW	3	17	4	0	0	0	24
WSW	1	21	4	0	0	0	26
W	2	25	0	0	0	0	27
WNW	9	23	2	0	0	0	34
NW	11	10	1	0	0	0	22
NNW	10	14	0	0	0	0	24
Variable	0	0	0	0	0	0	0
Total	111	298	110	24	4	0	547

Hours of calm in this stability class: 3
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	9	4	0	0	0	0	13
NNE	4	1	0	0	0	0	5
NE	7	5	2	0	0	0	14
ENE	2	3	2	3	0	0	10
E	4	3	2	1	0	0	10
ESE	3	6	5	0	0	0	14
SE	2	4	0	0	0	0	6
SSE	2	10	22	7	0	0	41
S	8	25	7	0	0	0	40
SSW	11	5	0	0	0	0	16
SW	6	2	0	0	0	0	8
WSW	9	4	2	0	0	0	15
W	5	6	0	0	0	0	11
WNW	9	11	0	0	0	0	20
NW	12	7	0	0	0	0	19
NNW	8	3	0	0	0	0	11
Variable	0	0	0	0	0	0	0
Total	101	99	42	11	0	0	253

Hours of calm in this stability class: 4
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	0	0	0	0	0	2
NNE	3	0	0	0	0	0	3
NE	2	0	0	1	0	0	3
ENE	0	1	2	3	0	0	6
E	3	1	3	0	0	0	7
ESE	2	2	3	1	0	0	8
SE	1	2	0	0	0	0	3
SSE	2	5	13	2	0	0	22
S	3	16	4	1	0	0	24
SSW	4	2	0	0	0	0	6
SW	4	7	0	0	0	0	11
WSW	8	0	0	0	0	0	8
W	8	2	0	0	0	0	10
WNW	8	5	0	0	0	0	13
NW	1	0	0	0	0	0	1
NNW	4	0	0	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	55	43	25	8	0	0	131

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	1	2	5	4	12
NNE	0	1	25	31	12	0	69
NE	0	1	24	11	2	0	38
ENE	0	4	8	3	0	0	15
E	0	8	0	0	3	0	11
ESE	0	3	5	0	0	0	8
SE	0	0	9	2	0	0	11
SSE	0	0	2	0	0	0	2
S	0	0	0	0	0	0	0
SSW	0	0	0	0	4	0	4
SW	0	0	3	4	5	1	13
WSW	0	0	0	10	11	1	22
W	0	0	10	6	24	1	41
WNW	0	0	0	18	2	0	20
NW	0	0	3	6	10	0	19
NNW	0	0	0	1	3	0	4
Variable	0	0	0	0	0	0	0
Total	0	17	90	94	81	7	289

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	2	2	2	0	6
NNE	0	4	5	11	1	0	21
NE	0	3	2	0	0	0	5
ENE	0	1	1	0	0	0	2
E	0	0	1	0	0	0	1
ESE	0	3	1	1	0	0	5
SE	0	0	5	1	0	0	6
SSE	0	0	5	0	0	0	5
S	0	0	0	0	0	0	0
SSW	0	0	1	1	0	0	2
SW	0	0	1	2	1	2	6
WSW	0	0	0	1	1	0	2
W	0	2	3	2	0	0	7
WNW	0	1	0	2	0	1	4
NW	0	0	2	1	3	0	6
NNW	0	1	0	0	1	0	2
Variable	0	0	0	0	0	0	0
Total	0	15	29	24	9	3	80

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	3	0	1	4	1	9
NNE	0	3	6	5	1	0	15
NE	0	4	2	3	1	0	10
ENE	0	2	1	0	0	0	3
E	0	3	2	1	1	0	7
ESE	0	3	1	0	0	0	4
SE	0	1	4	1	0	0	6
SSE	0	0	8	1	0	0	9
S	0	0	1	2	1	0	4
SSW	0	0	0	1	2	1	4
SW	0	0	3	4	3	1	11
WSW	0	1	1	4	0	1	7
W	0	1	0	4	3	1	9
WNW	0	1	0	4	0	0	5
NW	0	1	1	5	4	0	11
NNW	0	2	0	0	1	0	3
Variable	0	0	0	0	0	0	0
Total	0	25	30	36	21	5	117

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	10	18	27	32	37	124
NNE	1	5	34	39	11	1	91
NE	1	10	21	10	1	4	47
ENE	3	11	11	4	5	4	38
E	2	17	6	5	4	6	40
ESE	1	8	14	12	0	8	43
SE	2	8	14	7	4	4	39
SSE	0	8	32	24	3	0	67
S	0	1	10	10	0	2	23
SSW	0	2	4	5	15	3	29
SW	0	0	9	10	13	4	36
WSW	1	1	5	18	8	2	35
W	0	1	6	29	12	2	50
WNW	0	2	5	22	8	2	39
NW	1	4	5	24	5	0	39
NNW	0	4	6	4	2	1	17
Variable	0	0	0	0	0	0	0
Total	12	92	200	250	123	80	757

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	7	9	25	4	0	47
NNE	3	13	11	12	1	0	40
NE	2	14	9	1	3	0	29
ENE	1	6	6	1	1	4	19
E	0	13	5	6	8	7	39
ESE	0	8	14	5	5	7	39
SE	0	7	11	7	3	5	33
SSE	0	5	18	30	11	5	69
S	0	2	13	16	11	3	45
SSW	0	3	6	24	3	1	37
SW	0	1	10	30	0	0	41
WSW	0	2	5	21	2	1	31
W	1	1	6	17	0	0	25
WNW	0	1	5	12	1	0	19
NW	0	0	7	18	2	0	27
NNW	1	3	4	2	0	0	10
Variable	0	0	0	0	0	0	0
Total	10	86	139	227	55	33	550

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	9	6	1	0	0	18
NNE	1	6	8	2	0	0	17
NE	1	5	2	0	1	0	9
ENE	1	1	5	1	1	1	10
E	1	3	4	3	0	4	15
ESE	0	3	2	1	2	6	14
SE	1	3	6	7	4	0	21
SSE	1	3	17	10	9	2	42
S	0	6	11	17	6	5	45
SSW	1	0	8	5	2	0	16
SW	0	1	1	3	1	0	6
WSW	0	0	3	4	2	0	9
W	1	2	2	0	2	0	7
WNW	2	1	0	4	0	0	7
NW	3	1	1	4	0	0	9
NNW	0	5	5	2	0	0	12
Variable	0	0	0	0	0	0	0
Total	15	49	81	64	30	18	257

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: April - June 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	8	0	0	0	0	8
NNE	2	7	0	0	0	0	9
NE	0	1	0	0	0	0	1
ENE	0	0	0	0	0	0	0
E	0	1	1	0	0	7	9
ESE	0	2	3	0	3	6	14
SE	0	2	1	0	1	0	4
SSE	0	3	1	2	7	1	14
S	0	5	12	10	5	2	34
SSW	1	2	5	10	1	0	19
SW	1	2	0	5	1	0	9
WSW	0	0	1	1	0	0	2
W	0	0	2	0	0	0	2
WNW	1	1	0	0	0	0	2
NW	0	0	2	0	0	0	2
NNW	0	0	0	3	0	0	3
Variable	0	0	0	0	0	0	0
Total	5	34	28	31	18	16	132

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 2

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	5	18	1	0	0	24
NNE	0	15	16	0	0	0	31
NE	0	14	4	0	0	0	18
ENE	0	19	0	0	0	0	19
E	0	26	0	0	0	0	26
ESE	1	23	0	0	0	0	24
SE	0	14	2	0	0	0	16
SSE	0	5	7	0	0	0	12
S	0	2	1	0	0	0	3
SSW	0	1	8	3	0	0	12
SW	0	6	25	8	0	0	39
WSW	0	7	16	7	1	0	31
W	0	14	21	5	1	0	41
WNW	0	7	20	3	0	0	30
NW	0	6	11	0	0	0	17
NNW	0	4	0	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	1	168	149	27	2	0	347

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	4	1	0	0	0	5
NNE	0	4	1	0	0	0	5
NE	1	3	0	0	0	0	4
ENE	0	1	0	0	0	0	1
E	1	2	0	0	0	0	3
ESE	0	1	0	0	0	0	1
SE	0	7	1	0	0	0	8
SSE	0	7	11	0	0	0	18
S	0	3	2	0	0	0	5
SSW	0	0	4	0	0	0	4
SW	1	4	6	3	0	0	14
WSW	0	3	5	2	0	0	10
W	0	8	5	2	0	0	15
WNW	0	4	2	0	0	0	6
NW	0	2	3	0	0	0	5
NNW	0	1	1	1	0	0	3
Variable	0	0	0	0	0	0	0
Total	3	54	42	8	0	0	107

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	8	3	1	0	0	12
NNE	0	4	3	0	0	0	7
NE	2	3	0	0	0	0	5
ENE	0	3	0	0	0	0	3
E	0	5	0	0	0	0	5
ESE	2	7	0	0	0	0	9
SE	1	10	3	0	0	0	14
SSE	0	9	8	2	0	0	19
S	0	6	1	0	0	0	7
SSW	0	2	4	2	0	0	8
SW	0	5	5	3	0	0	13
WSW	0	3	0	2	0	0	5
W	0	3	4	2	0	0	9
WNW	0	8	3	0	0	0	11
NW	0	1	3	0	0	0	4
NNW	0	2	2	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	5	79	39	12	0	0	135

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	5	32	17	0	0	0	54
NNE	2	10	1	0	0	0	13
NE	5	8	0	0	0	0	13
ENE	3	3	0	0	0	0	6
E	7	5	0	0	0	0	12
ESE	5	13	0	0	0	0	18
SE	8	16	5	0	0	0	29
SSE	2	27	48	5	0	0	82
S	6	35	8	0	0	0	49
SSW	1	22	12	13	1	0	49
SW	4	13	27	8	1	0	53
WSW	3	15	20	2	0	0	40
W	0	24	16	2	0	0	42
WNW	5	18	16	2	0	0	41
NW	3	13	6	0	0	0	22
NNW	3	17	6	0	0	0	26
Variable	0	1	0	0	0	0	1
Total	62	272	182	32	2	0	550

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	15	14	3	0	0	0	32
NNE	3	5	1	0	0	0	9
NE	12	11	0	0	0	0	23
ENE	3	6	0	0	0	0	9
E	5	7	0	0	0	0	12
ESE	3	9	0	0	0	0	12
SE	5	14	3	0	0	0	22
SSE	11	21	40	3	0	0	75
S	16	87	8	0	0	0	111
SSW	25	37	3	0	0	0	65
SW	19	18	4	0	0	0	41
WSW	18	23	3	0	0	0	44
W	9	30	0	0	0	0	39
WNW	12	18	0	0	0	0	30
NW	8	30	0	0	0	0	38
NNW	11	17	2	0	0	0	30
Variable	0	0	0	0	0	0	0
Total	175	347	67	3	0	0	592

Hours of calm in this stability class: 5
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	6	3	0	0	0	0	9
NNE	3	1	0	0	0	0	4
NE	3	5	0	0	0	0	8
ENE	1	3	0	0	0	0	4
E	1	3	2	0	0	0	6
ESE	2	3	1	0	0	0	6
SE	0	6	0	1	0	0	7
SSE	2	12	8	2	0	0	24
S	7	33	4	0	0	0	44
SSW	23	20	0	0	0	0	43
SW	18	10	0	0	0	0	28
WSW	34	9	0	0	0	0	43
W	16	26	0	0	0	0	42
WNW	13	4	0	0	0	0	17
NW	12	24	0	0	0	0	36
NNW	5	9	0	0	0	0	14
Variable	0	0	0	0	0	0	0
Total	146	171	15	3	0	0	335

Hours of calm in this stability class: 3
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	0	0	0	0	0	2
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	2	0	0	0	0	2
E	1	1	0	0	0	0	2
ESE	1	1	0	0	0	0	2
SE	0	0	0	0	0	0	0
SSE	0	2	0	0	0	0	2
S	6	7	1	0	0	0	14
SSW	9	3	0	0	0	0	12
SW	10	2	0	0	0	0	12
WSW	22	5	0	0	0	0	27
W	25	8	0	0	0	0	33
WNW	9	4	0	0	0	0	13
NW	3	3	0	0	0	0	6
NNW	1	0	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	89	38	1	0	0	0	128

Hours of calm in this stability class: 6
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	8	8	2	0	18
NNE	0	3	23	8	0	0	34
NE	0	2	13	2	0	0	17
ENE	0	10	10	0	0	0	20
E	0	12	5	0	0	0	17
ESE	0	12	10	1	0	0	23
SE	0	9	16	6	0	0	31
SSE	0	0	6	2	0	0	8
S	0	0	0	1	0	0	1
SSW	0	0	2	4	3	0	9
SW	0	2	10	16	6	1	35
WSW	0	2	6	12	5	4	29
W	0	3	12	19	7	9	50
WNW	0	1	8	12	9	0	30
NW	0	0	12	8	1	0	21
NNW	0	0	3	1	0	0	4
Variable	0	0	0	0	0	0	0
Total	0	56	144	100	33	14	347

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	2	0	0	0	4
NNE	0	3	3	0	0	0	6
NE	0	1	0	0	0	0	1
ENE	0	3	1	0	0	0	4
E	0	0	0	0	0	0	0
ESE	0	1	2	1	0	0	4
SE	0	3	3	1	0	0	7
SSE	0	2	12	5	0	0	19
S	0	0	2	2	0	0	4
SSW	0	0	1	2	0	0	3
SW	0	1	4	4	3	0	12
WSW	0	1	3	6	1	0	11
W	0	1	4	3	2	3	13
WNW	0	0	5	2	1	1	9
NW	0	1	3	2	0	0	6
NNW	0	1	2	0	1	0	4
Variable	0	0	0	0	0	0	0
Total	0	20	47	28	8	4	107

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	3	5	0	1	10
NNE	0	2	4	2	0	0	8
NE	0	0	0	0	0	0	0
ENE	0	7	1	0	0	0	8
E	0	2	0	1	0	0	3
ESE	0	3	2	1	0	0	6
SE	0	9	3	5	1	0	18
SSE	0	3	8	6	0	0	17
S	0	3	3	3	0	0	9
SSW	0	0	1	3	1	0	5
SW	0	0	7	6	3	2	18
WSW	0	2	2	0	1	1	6
W	0	1	0	3	2	2	8
WNW	0	1	5	3	1	0	10
NW	0	0	2	4	0	0	6
NNW	0	0	2	1	0	0	3
Variable	0	0	0	0	0	0	0
Total	0	34	43	43	9	6	135

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	3	19	29	2	0	53
NNE	0	4	8	3	0	0	15
NE	2	11	6	0	0	0	19
ENE	0	3	3	1	0	0	7
E	0	7	1	1	0	0	9
ESE	1	5	6	1	0	0	13
SE	1	13	15	7	1	0	37
SSE	3	3	41	24	6	0	77
S	0	3	23	15	2	0	43
SSW	1	2	13	12	8	7	43
SW	0	2	7	30	13	7	59
WSW	0	6	13	13	8	2	42
W	0	1	13	24	9	1	48
WNW	0	4	13	16	7	1	41
NW	0	0	11	10	2	1	24
NNW	1	4	6	7	1	0	19
Variable	0	0	0	0	0	0	0
Total	9	71	198	193	59	19	549

Hours of calm in this stability class: 1
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	5	17	12	1	0	36
NNE	1	9	13	5	2	0	30
NE	1	6	2	0	0	0	9
ENE	1	7	0	8	0	0	16
E	1	7	8	1	0	0	17
ESE	0	7	5	9	2	0	23
SE	1	6	9	10	1	1	28
SSE	0	10	16	35	13	1	75
S	2	7	27	43	7	0	86
SSW	1	5	19	33	1	0	59
SW	3	10	21	23	0	0	57
WSW	2	5	14	21	1	1	44
W	2	1	9	20	2	0	34
WNW	1	5	9	20	0	0	35
NW	1	4	6	14	0	0	25
NNW	1	0	8	14	0	0	23
Variable	0	0	0	0	0	0	0
Total	19	94	183	268	30	3	597

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	13	11	0	0	26
NNE	0	3	1	4	0	0	8
NE	0	6	6	0	0	0	12
ENE	1	1	2	4	1	0	9
E	0	1	2	5	3	0	11
ESE	1	0	1	1	0	1	4
SE	1	2	3	2	1	1	10
SSE	0	6	7	9	2	1	25
S	0	5	15	23	3	0	46
SSW	2	11	18	28	0	0	59
SW	3	4	5	17	0	0	29
WSW	2	4	6	13	0	0	25
W	1	1	2	18	2	0	24
WNW	0	1	7	13	0	0	21
NW	2	1	9	5	0	0	17
NNW	0	2	2	6	2	0	12
Variable	0	0	0	0	0	0	0
Total	13	50	99	159	14	3	338

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: July - September 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	2	2	1	5	0	0	10
NNE	4	3	3	0	0	0	10
NE	1	2	0	0	0	0	3
ENE	1	1	0	1	0	0	3
E	2	4	0	0	1	0	7
ESE	3	1	0	0	1	0	5
SE	1	1	0	0	0	0	2
SSE	2	2	1	1	1	0	7
S	0	4	4	5	2	0	15
SSW	2	5	5	10	0	0	22
SW	0	5	3	5	0	0	13
WSW	1	0	1	1	0	0	3
W	1	0	2	15	0	0	18
WNW	0	1	2	7	0	0	10
NW	0	0	2	1	0	0	3
NNW	1	2	0	0	0	0	3
Variable	0	0	0	0	0	0	0
Total	21	33	24	51	5	0	134

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 0

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	5	0	4	0	9
NNE	0	5	26	0	0	0	31
NE	0	7	3	0	0	0	10
ENE	0	9	0	0	0	0	9
E	0	11	0	0	0	0	11
ESE	0	5	2	0	0	0	7
SE	0	2	0	0	0	0	2
SSE	0	3	3	0	0	0	6
S	0	0	1	0	0	0	1
SSW	0	0	7	4	0	0	11
SW	0	0	12	3	4	1	20
WSW	0	3	22	9	0	0	34
W	0	2	23	0	0	0	25
WNW	0	2	7	0	0	0	9
NW	0	2	6	0	0	0	8
NNW	0	0	4	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	0	51	121	16	8	1	197

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	3	2	0	0	6
NNE	0	1	1	0	0	0	2
NE	0	0	0	0	0	0	0
ENE	0	2	0	0	0	0	2
E	0	1	0	0	0	0	1
ESE	0	2	0	0	0	0	2
SE	0	3	0	0	0	0	3
SSE	0	0	0	0	0	0	0
S	0	0	2	0	0	0	2
SSW	0	0	1	4	0	0	5
SW	0	0	3	2	0	1	6
WSW	0	0	11	3	0	0	14
W	0	3	7	0	0	0	10
WNW	0	0	6	0	0	0	6
NW	0	1	3	2	0	0	6
NNW	0	0	2	1	0	0	3
Variable	0	0	0	0	0	0	0
Total	0	14	39	14	0	1	68

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	5	0	0	0	5
NNE	0	1	2	0	0	0	3
NE	0	3	0	0	0	0	3
ENE	0	1	0	0	0	0	1
E	0	3	0	0	0	0	3
ESE	0	1	1	1	0	0	3
SE	0	1	0	4	0	0	5
SSE	0	1	5	2	0	0	8
S	0	1	4	0	0	0	5
SSW	0	0	3	1	0	0	4
SW	0	1	6	3	4	1	15
WSW	0	3	6	2	1	0	12
W	0	5	9	2	0	0	16
WNW	0	3	12	0	0	0	15
NW	1	5	7	0	0	0	13
NNW	0	2	6	2	0	0	10
Variable	0	0	0	0	0	0	0
Total	1	31	66	17	5	1	121

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	9	30	17	3	1	61
NNE	0	5	16	3	0	0	24
NE	1	2	6	0	0	0	9
ENE	3	4	8	1	0	0	16
E	2	0	7	5	0	0	14
ESE	0	1	1	3	0	0	5
SE	2	3	8	9	3	0	25
SSE	0	3	23	48	15	1	90
S	2	14	23	10	1	0	50
SSW	5	14	25	9	0	0	53
SW	1	18	25	34	7	0	85
WSW	1	19	53	22	3	0	98
W	1	38	60	19	1	0	119
WNW	6	36	58	2	0	0	102
NW	3	31	27	11	0	0	72
NNW	1	32	39	4	16	0	92
Variable	0	0	0	0	0	0	0
Total	29	229	409	197	49	2	915

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 5
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	10	4	0	0	0	14
NNE	0	8	2	0	0	0	10
NE	2	2	0	0	0	0	4
ENE	0	3	1	0	0	0	4
E	1	0	2	0	0	0	3
ESE	2	4	1	0	0	0	7
SE	2	6	4	0	0	0	12
SSE	2	5	19	6	4	2	38
S	6	23	24	2	0	0	55
SSW	7	30	18	0	0	0	55
SW	1	20	7	1	0	0	29
WSW	3	16	7	0	0	0	26
W	6	23	5	0	0	0	34
WNW	7	66	28	0	0	0	101
NW	7	52	19	0	0	0	78
NNW	3	22	12	0	0	0	37
Variable	0	0	0	0	0	0	0
Total	49	290	153	9	4	2	507

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 1
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	4	0	0	0	0	5
NNE	1	0	0	0	0	0	1
NE	0	1	0	0	0	0	1
ENE	1	0	0	0	0	0	1
E	1	0	0	0	0	0	1
ESE	1	2	0	0	0	0	3
SE	1	2	0	0	0	0	3
SSE	1	7	10	0	0	0	18
S	8	14	5	0	0	0	27
SSW	6	17	1	0	0	0	24
SW	5	19	0	0	0	0	24
WSW	7	3	1	0	0	0	11
W	6	22	0	0	0	0	28
WNW	9	33	0	0	0	0	42
NW	4	21	0	0	0	0	25
NNW	1	5	0	0	0	0	6
Variable	0	0	0	0	0	0	0
Total	53	150	17	0	0	0	220

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 35 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	0	0	0	0	0	1
NNE	0	0	0	0	0	0	0
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	0	0	0	0	0	0	0
ESE	2	0	0	0	0	0	2
SE	1	4	0	0	0	0	5
SSE	0	1	4	0	0	0	5
S	1	6	4	0	0	0	11
SSW	2	2	0	0	0	0	4
SW	5	5	0	0	0	0	10
WSW	12	12	0	0	0	0	24
W	20	68	0	0	0	0	88
WNW	4	8	0	0	0	0	12
NW	3	4	0	0	0	0	7
NNW	1	0	0	0	0	0	1
Variable	0	0	0	0	0	0	0
Total	52	110	8	0	0	0	170

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Extremely Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	1	2	0	4	7
NNE	0	2	12	13	0	0	27
NE	0	1	12	2	0	0	15
ENE	0	1	5	0	0	0	6
E	0	3	8	0	0	0	11
ESE	0	6	3	0	0	0	9
SE	0	1	3	0	0	0	4
SSE	0	2	4	0	0	0	6
S	0	0	0	0	0	0	0
SSW	0	0	2	0	1	0	3
SW	0	0	5	8	3	2	18
WSW	0	0	4	15	10	3	32
W	0	0	14	18	5	0	37
WNW	0	0	4	2	0	0	6
NW	0	1	4	6	1	0	12
NNW	0	0	0	4	0	0	4
Variable	0	0	0	0	0	0	0
Total	0	17	81	70	20	9	197

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Moderately Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	0	1	0	2	4
NNE	0	0	2	3	0	0	5
NE	0	0	0	0	0	0	0
ENE	0	1	0	0	0	0	1
E	0	2	0	0	0	0	2
ESE	0	1	0	0	0	0	1
SE	0	0	2	0	0	0	2
SSE	0	1	1	0	0	0	2
S	0	0	0	1	0	0	1
SSW	0	0	1	1	2	0	4
SW	0	0	0	3	3	1	7
WSW	0	0	1	5	2	0	8
W	0	1	5	9	2	0	17
WNW	0	0	0	3	1	0	4
NW	0	0	3	1	4	0	8
NNW	0	0	0	1	1	0	2
Variable	0	0	0	0	0	0	0
Total	0	7	15	28	15	3	68

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Slightly Unstable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	0	3	3	1	0	7
NNE	0	0	1	2	0	0	3
NE	0	2	1	0	0	0	3
ENE	0	0	1	0	0	0	1
E	0	2	1	0	0	0	3
ESE	0	2	0	0	0	1	3
SE	0	0	1	0	0	4	5
SSE	0	1	2	3	0	0	6
S	0	0	1	2	1	0	4
SSW	0	0	2	4	1	0	7
SW	0	0	2	5	2	4	13
WSW	0	0	3	4	3	2	12
W	0	2	5	6	5	0	18
WNW	0	1	7	3	0	0	11
NW	1	0	5	7	2	0	15
NNW	0	3	1	5	1	0	10
Variable	0	0	0	0	0	0	0
Total	1	13	36	44	16	11	121

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Neutral - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	1	3	8	33	14	15	74
NNE	0	0	3	12	15	0	30
NE	0	1	3	6	1	0	11
ENE	0	2	4	5	0	0	11
E	0	4	5	6	3	1	19
ESE	0	0	2	1	3	0	6
SE	1	4	0	18	8	13	44
SSE	0	1	3	13	19	16	52
S	0	1	6	12	15	10	44
SSW	0	5	7	16	7	3	38
SW	0	3	14	23	30	14	84
WSW	0	1	9	30	34	5	79
W	0	2	31	40	52	13	138
WNW	1	5	18	47	8	0	79
NW	0	10	35	25	16	1	87
NNW	0	8	21	32	6	20	87
Variable	0	0	0	0	0	0	0
Total	3	50	169	319	231	111	883

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 37
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Slightly Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	1	8	19	1	0	29
NNE	0	6	5	4	3	0	18
NE	0	1	5	0	0	0	6
ENE	0	1	2	1	0	0	4
E	0	1	4	2	0	0	7
ESE	0	3	1	1	2	0	7
SE	0	1	1	4	1	0	7
SSE	1	1	3	5	8	10	28
S	1	1	5	19	23	1	50
SSW	0	1	10	29	2	0	42
SW	0	1	13	33	4	0	51
WSW	0	4	9	13	8	0	34
W	0	1	7	6	4	0	18
WNW	0	3	11	33	12	0	59
NW	0	1	10	66	16	0	93
NNW	0	1	8	42	2	0	53
Variable	0	0	0	0	0	0	0
Total	2	28	102	277	86	11	506

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 2
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Moderately Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	10	5	0	0	17
NNE	1	2	1	3	0	0	7
NE	1	1	3	0	0	0	5
ENE	0	1	1	0	0	0	2
E	1	0	0	0	0	0	1
ESE	1	2	0	0	0	0	3
SE	0	1	1	1	1	0	4
SSE	2	1	5	6	6	0	20
S	0	3	3	8	8	0	22
SSW	0	1	7	13	2	0	23
SW	2	1	9	14	4	0	30
WSW	0	0	6	7	1	0	14
W	3	3	4	1	2	0	13
WNW	0	0	0	8	0	0	8
NW	1	1	3	30	4	0	39
NNW	0	2	1	9	0	0	12
Variable	0	0	0	0	0	0	0
Total	12	21	54	105	28	0	220

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Zion Nuclear Station

Period of Record: October - December 2010
 Stability Class - Extremely Stable - 250Ft-33Ft Delta-T (F)
 Winds Measured at 250 Feet

Wind Direction	Wind Speed (in mph)						Total
	1-3	4-7	8-12	13-18	19-24	> 24	
N	0	2	1	4	0	0	7
NNE	1	0	0	0	0	0	1
NE	0	0	0	0	0	0	0
ENE	0	0	0	0	0	0	0
E	1	1	1	0	0	0	3
ESE	0	2	1	0	0	0	3
SE	0	3	0	0	0	0	3
SSE	2	1	1	3	1	0	8
S	0	2	8	5	5	0	20
SSW	0	1	7	4	2	0	14
SW	3	3	3	4	0	0	13
WSW	0	5	5	1	0	0	11
W	2	5	5	5	2	0	19
WNW	0	2	8	20	12	0	42
NW	1	2	10	6	3	0	22
NNW	0	0	4	0	0	0	4
Variable	0	0	0	0	0	0	0
Total	10	29	54	52	25	0	170

Hours of calm in this stability class: 0
 Hours of missing wind measurements in this stability class: 0
 Hours of missing stability measurements in all stability classes: 4

Intentionally left blank

APPENDIX G

ANNUAL RADIOLOGICAL GROUNDWATER PROTECTION PROGRAM REPORT (ARGPPR)

Docket No: 50-295
50-304

ZION NUCLEAR POWER STATION UNITS 1 and 2

Annual Radiological
Groundwater Protection Program Report

1 January Through 31 December 2010

Prepared By

Teledyne Brown Engineering
Environmental Services



Zion Nuclear Power Station
Zion, IL 60099

May 2011

Table Of Contents

I. Summary and Conclusions.....	1
II. Introduction	3
A. Objectives of the RGPP	3
B. Implementation of the Objectives.....	3
C. Program Description	4
D. Characteristics of Tritium (H-3).....	4
III. Program Description	5
A. Sample Analysis.....	5
B. Data Interpretation.....	6
C. Background Analysis.....	7
1. Background Concentrations of Tritium	8
A. Groundwater and Surface Water Results	10
B. Drinking Water Well Survey	10
C. Summary of Results – Inter-laboratory Comparison Program.....	10
D. Leaks, Spills, and Releases.....	10
E. Trends	11
F. Investigations.....	11
G. Actions Taken	11

Appendices

Appendix A Location Designation

Tables

Table A-1 Radiological Groundwater Protection Program - Sampling Locations, Distance and Direction, Zion Nuclear Power Station, 2010

Figures

Figure A-1 Radiological Groundwater Protection Program Groundwater and Surface Water Locations of the Zion Nuclear Power Station, 2010

Appendix B Data Tables

Tables

Table B-I.1 Concentrations of Tritium in Groundwater Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table B-I.2 Concentrations of Gamma Emitters in Groundwater Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table B-II.1 Concentrations of Tritium in Surface Water Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

Table B-II.2 Concentrations of Gamma Emitters in Surface Water Samples Collected in the Vicinity of Zion Nuclear Power Station, 2010.

I. Summary and Conclusions

In 2006, Exelon instituted a comprehensive program to evaluate the impact of station operations on groundwater and surface water in the vicinity of Zion Nuclear Power Station. This is the fifth in a series of annual reports on the status of the Radiological Groundwater Protection Program (RGPP) conducted at Zion Nuclear Power Station. This report covers both groundwater and surface water samples, collected from the environment, on station property in 2010. During that time period, 24 analyses were performed on 16 samples from eight locations. Phase 1 of the monitoring was part of a comprehensive study initiated by Exelon to determine whether groundwater or surface water at and in the vicinity of Zion Nuclear Power Station had been adversely impacted by any releases of radionuclides. Phase 1 was conducted by Conestoga Rovers and Associates (CRA) and the conclusions were made available to state and federal regulators as well as the public in station specific reports.

Phase 2 of the RGPP was conducted by *ZionSolutions* (Exelon was responsible for the program up to 8/31/2010; *ZionSolutions* became the licensee on 9/1/2010, thus assuming responsibility for the RGPP) personnel to initiate follow up of Phase 1 and begin long-term monitoring at groundwater and surface water locations selected during Phase 1. All analytical results from Phase 2 monitoring are reported herein.

In assessing all the data gathered for this report, it was concluded that the operation of Zion Nuclear Power Station had no adverse radiological impact on the environment, and there are no known active releases into the groundwater at Zion Nuclear Power Station.

Gamma-emitting radionuclides were not detected at concentrations greater than their respective Lower Limits of Detection (LLDs) as specified in the Offsite Dose Calculation Manual (ODCM) in any of the groundwater or surface water samples.

Strontium-90 was not analyzed in 2010.

Tritium was not detected in any of the groundwater or surface water samples analyzed in 2010. In the case of tritium, *ZionSolutions* specified that it's laboratories achieve a lower limit of detection 10 times lower than that required by federal regulation.

Intentionally left blank

II. Introduction

The Zion Nuclear Power Station (ZNPS), consisting of two 1100 MWt pressurized water reactor was owned and operated by Exelon Corporation, is located in Zion, Illinois adjacent to Lake Michigan. Unit No. 1 went critical in December 1973. Unit No. 2 went critical in September 1974. The plant permanently ceased operation in January of 1998 and has been permanently defueled. The site is located in northeast Illinois on the western shore of Lake Michigan, approximately 50 miles north of Chicago, Illinois.

This report covers those analyses performed by Teledyne Brown Engineering (TBE) and Environmental Inc. (Midwest Labs) on samples collected in 2010.

A. Objective of the RGPP

The long-term objectives of the RGPP are as follows:

1. Identify suitable locations to monitor and evaluate potential impacts from station operations before significant radiological impact to the environment and potential drinking water sources.
2. Understand the local hydrogeologic regime in the vicinity of the station and maintain up-to-date knowledge of flow patterns on the surface and shallow subsurface.
3. Perform routine water sampling and radiological analysis of water from selected locations.
4. Report new leaks, spills, or other detections with potential radiological significance to stakeholders in a timely manner.
5. Regularly assess analytical results to identify adverse trends.
6. Take necessary corrective actions to protect groundwater resources.

B. Implementation of the Objectives

The objectives identified have been implemented at Zion Nuclear Power Station as discussed below:

1. Exelon and its consultant identified locations as described in the Phase 1 study. Phase 1 studies were conducted by Conestoga Rovers and Associates (CRA) and the results and conclusions were made available to state and federal regulators as well as the public in station specific reports.

2. The Zion Nuclear Power Station reports describe the local hydrogeologic regime. Periodically, the flow patterns on the surface and shallow subsurface are updated based on ongoing measurements.
3. Zion Nuclear Power Station will continue to perform routine sampling and radiological analysis of water from selected locations.
4. Zion Nuclear Power Station has implemented new procedures to identify and report new leaks, spills, or other detections with potential radiological significance in a timely manner.
5. Zion Nuclear Power Station staff and consulting hydrogeologist assess analytical results on an ongoing basis to identify adverse trends.

C. Program Description

1. Sample Collection

Sample locations can be found in Table A--1 and Figures A-1 and A-2, Appendix A.

Groundwater and Surface Water

Samples of water are collected, managed, transported and analyzed in accordance with approved procedures following EPA methods. Groundwater samples were collected. Sample locations, sample collection frequencies and analytical frequencies are controlled in accordance with approved station procedures. Contractor and/or station personnel are trained in the collection, preservation management, and shipment of samples, as well as in documentation of sampling events. Analytical laboratories are subject to internal quality assurance programs, industry cross-check programs, as well as nuclear industry audits. Station personnel review and evaluate all analytical data deliverables as data are received.

Analytical data results are reviewed by both station personnel and an independent hydrogeologist for adverse trends or changes to hydrogeologic conditions.

D. Characteristics of Tritium (H-3)

Tritium (chemical symbol H-3) is a radioactive isotope of hydrogen. The

most common form of tritium is tritium oxide, which is also called "tritiated water". The chemical properties of tritium are essentially those of ordinary hydrogen.

Tritiated water behaves the same as ordinary water in both the environment and the body. Tritium can be taken into the body by drinking water, breathing air, eating food, or absorption through skin. Once tritium enters the body, it disperses quickly and is uniformly distributed throughout the body. Tritium is excreted primarily through urine with a clearance rate characterized by an effective biological half-life of about 14 days. Within one month or so after ingestion, essentially all tritium is cleared. Organically bound tritium (tritium that is incorporated in organic compounds) can remain in the body for a longer period.

Tritium is produced naturally in the upper atmosphere when cosmic rays strike air molecules. Tritium is also produced during nuclear weapons explosions, as a by-product in reactors producing electricity, and in special production reactors, where the isotopes lithium-7 and/or boron-10 are activated to produce tritium. Like normal water, tritiated water is colorless and odorless. Tritiated water behaves chemically and physically like non-tritiated water in the subsurface, and therefore tritiated water will travel at the same velocity as the average groundwater velocity.

Tritium has a half-life of approximately 12.3 years. It decays spontaneously to helium-3 (^3He). This radioactive decay releases a beta particle (low-energy electron). The radioactive decay of tritium is the source of the health risk from exposure to tritium. Tritium is one of the least dangerous radionuclides because it emits very weak radiation and leaves the body relatively quickly. Since tritium is almost always found as water, it goes directly into soft tissues and organs. The associated dose to these tissues is generally uniform and is dependent on the water content of the specific tissue.

III. Program Description

A. Sample Analysis

This section describes the general analytical methodologies used by TBE to analyze the environmental samples for radioactivity for the Zion Nuclear Power Station RGPP in 2010.

In order to achieve the stated objectives, the current program includes the following analyses:

1. Concentrations of gamma emitters in groundwater and surface water.
2. Concentrations of strontium in groundwater and surface water.
3. Concentrations of tritium in groundwater and surface water.

B. Data Interpretation

The radiological data collected prior to Zion Nuclear Power Station becoming operational were used as a baseline with which these operational data were compared. For the purpose of this report, Zion Nuclear Power Station was considered operational at initial criticality. Several factors were important in the interpretation of the data:

1. Lower Limit of Detection and Minimum Detectable Concentration

The lower limit of detection (LLD) is specified by federal regulation as a minimum sensitivity value that must be achieved routinely by the analytical parameter.

2. Laboratory Measurements Uncertainty

The estimated uncertainty in measurement of tritium in environmental samples is frequently on the order of 50% of the measurement value.

Statistically, the exact value of a measurement is expressed as a range with a stated level of confidence. The convention is to report results with a 95% level of confidence. The uncertainty comes from calibration standards, sample volume or weight measurements, sampling uncertainty and other factors.

Zion *Solutions* reports the uncertainty of a measurement created by statistical process (counting error) as well as all sources of error (Total Propagated Uncertainty or TPU). Each result has two values calculated. Zion *Solutions* reports the TPU by following the result with plus or minus \pm the estimated sample standard deviation, as TPU, that is obtained by propagating all sources of analytical uncertainty in measurements.

Analytical uncertainties are reported at the 95% confidence level in this report for reporting consistency with the AREOR.

C. Background Analysis

A pre-operational radiological environmental monitoring program (pre-operational REMP) was conducted to establish background radioactivity levels prior to operation of the Station. The environmental media sampled and analyzed during the pre-operational REMP were atmospheric radiation, fall-out, domestic water, surface water, marine life, and foodstuffs. The results of the monitoring were detailed in the report entitled, Environmental Radiological Monitoring for Zion Nuclear Power Station, Commonwealth Edison Company, Annual Report 1973, May 1974.

The pre-operational REMP contained analytical results from samples collected from the surface water and groundwater.

Tritium levels in Lake Michigan water were studied in the vicinity of Zion Station throughout 1970. The concentration of tritium in the surface water samples from the Lake at Zion ranged from approximately 311 ± 20 pCi/L to 374 ± 34 pCi/L and averaged 340 pCi/L. There was no statistical difference in average tritium concentrations among the stations (eight stations from Kenosha to Waukegan).

Prior to 1998, surface water samples were collected at the following six locations along Lake Michigan:

- Kenosha, Wisconsin (intake located 10 miles north of the station)
- Lake County Public Water District (intake located 1.1 miles north of the Station)
- Waukegan, Illinois (intake located 6 miles south of the Station)
- North Chicago, Illinois (intake located 10 miles south of the Station)
- Great Lakes NTS (intake located 13 miles south of the Station)
- Lake Forest, Illinois (intake located 16.5 miles south of the Station)

After 1998, surface water samples were collected at the following four locations along Lake Michigan:

- Kenosha, Wisconsin (intake located 10 miles north of the station)
- Lake County Public Water District (intake located 1.1 miles north of the Station)
- Waukegan, Illinois (intake located 6 miles south of the Station)
- Lake Forest, Illinois (intake located 16.5 miles south of the Station)

Lake Michigan surface water data are collected as part of the REMP. Tritium concentrations in surface water samples from Lake Michigan ranged from non-detect to 660 pCi/L.

Groundwater was collected from one off-site well on a quarterly basis. Gamma isotopic, radiostrontium and tritium analyses were performed on all samples. Strontium-89, strontium-90, tritium and gamma emitters were below their respective LLDs.

1. Background Concentrations of Tritium

The purpose of the following discussion is to summarize background measurements of tritium in various media performed by others. Additional detail may be found by consulting references (CRA 2006).

a. Tritium Production

Tritium is created in the environment from naturally occurring processes both cosmic and subterranean, as well as from anthropogenic (i.e., man-made) sources. In the upper atmosphere, "Cosmogenic" tritium is produced from the bombardment of stable nuclides and combines with oxygen to form tritiated water, which will then enter the hydrologic cycle. Below ground, "lithogenic" tritium is produced by the bombardment of natural lithium present in crystalline rocks by neutrons produced by the radioactive decay of naturally abundant uranium and thorium. Lithogenic production of tritium is usually negligible compared to other sources due to the limited abundance of lithium in rock. The lithogenic tritium is introduced directly to groundwater.

A major anthropogenic source of tritium and strontium-90 comes from the former atmospheric testing of thermonuclear weapons. Levels of tritium in precipitation increased significantly during the 1950s and early 1960s, and later with additional testing, resulting in the release of significant amounts of tritium to the atmosphere. The Canadian heavy water nuclear power reactors, other commercial power reactors, nuclear research and weapons production continue to influence tritium concentrations in the environment.

b. Precipitation Data

Precipitation samples are routinely collected at stations around the world for the analysis of tritium and other radionuclides. Two publicly available databases that provide tritium concentrations in precipitation are Global Network of Isotopes in Precipitation (GNIP) and USEPA's RadNet

database. GNIP provides tritium precipitation concentration data for samples collected world wide from 1960 to 2006. RadNet provides tritium precipitation concentration data for samples collected at stations through out the U.S. from 1960 up to and including 2006. Based on GNIP data for sample stations located in the U.S. Midwest, tritium concentrations peaked around 1963. This peak, which approached 10,000 pCi/L for some stations, coincided with the atmospheric testing of thermonuclear weapons. Tritium concentrations in surface water showed a sharp decline up until 1975 followed by a gradual decline since that time. Tritium concentrations in Midwest precipitation have typically been below 100 pCi/L since around 1980. Tritium concentrations in wells may still be above the 200 pCi/L detection limit from the external causes described above. Water from previous years and decades is naturally captured in groundwater, so some well water sources today are affected by the surface water from the 1960s that were elevated in tritium.

c. Surface Water Data

Tritium concentrations are routinely measured in large surface water bodies, including Lake Michigan and the Mississippi River. Illinois surface water data were typically less than 100 pCi/L.

The USEPA RadNet surface water data typically has a reported 'Combined Standard Uncertainty' of 35 to 50 pCi/L. According to USEPA, this corresponds to a ± 70 to 100 pCi/L 95% confidence bound on each given measurement. Therefore, the typical background data provided may be subject to measurement uncertainty of approximately ± 70 to 100 pCi/L.

The radio-analytical laboratory is counting tritium results to an Exelon specified LLD of 200 pCi/L. Typically, the lowest positive measurement will be reported within a range of 40 – 240 pCi/L or 140 ± 100 pCi/L. Clearly, these sample results cannot be distinguished as different from background at this concentration.

IV. Results and Discussion

A. Groundwater and Surface Water Results

Groundwater and Surface Water

Samples were collected from on -site wells throughout the year in accordance with the station radiological groundwater protection program. Analytical results and anomalies are discussed below.

Tritium

Samples from all locations were analyzed for tritium activity (Table B–I.1, Appendix B) (Table B–II.1, Appendix B). Tritium was not detected in any of the groundwater or surface water samples analyzed. Zion Nuclear Power Station does not have any off-site wells and therefore there is no risk to off-site users.

Strontium

Strontium-90 was not analyzed in 2010.

Gamma Emitters

Naturally occurring Potassium-40 was detected in four of seven groundwater samples. The concentrations ranged from 53 to 207 pCi/l. Other gamma-emitting radionuclides were not detected in either groundwater or surface water samples analyzed (Table B–I.2, Appendix B) (Table B–II.1, Appendix B)

B. Drinking Water Well Survey

A drinking water well survey was conducted during the summer 2006 by CRA (CRA 2006) around the Zion Nuclear Power Station.

C. Summary of Results – Inter-Laboratory Comparison Program

Inter-Laboratory Comparison Program results for TBE and Environmental Inc. (Midwest Labs) are presented in the AREOR.

D. Leaks, Spills, and Releases

There were no leaks, spills or releases.

E. Trends

There are no previously identified plumes therefore there are no trends.

F. Investigations

Conclusions from the Phase 1 report have been made available to state and federal regulators as well as the public in station specific reports.

G. Actions Taken

1. Compensatory Actions

There have been no station events requiring compensatory actions at the Zion Nuclear Power Station.

2. Installation of Monitoring Wells

No new wells were required to be installed.

3. Actions to Recover/Reverse Plumes

There have been no station events requiring actions to recover/reverse any plumes.

Intentionally left blank

APPENDIX A

LOCATION & DIRECTION

ATTACHMENT 1: Sampling Locations for the Radiological Groundwater Protection Program, Zion Station, 2010.

Site	Site Type	Temporary/Permanent	Distance
MW-ZN-01S	Monitoring Well	Permanent	On-Site
MW-ZN-02S	Monitoring Well	Permanent	On-Site
MW-ZN-03S	Monitoring Well	Permanent	On-Site
MW-ZN-04S	Monitoring Well	Permanent	On-Site
MW-ZN-05S	Monitoring Well	Permanent	On-Site
MW-ZN-06S	Monitoring Well	Permanent	On-Site
MW-ZN-07S	Monitoring Well	Permanent	On-Site
MW-ZN-08S	Monitoring Well	Permanent	On-Site
MW-ZN-09S	Monitoring Well	Permanent	On-Site
MW-ZN-10S	Monitoring Well	Permanent	On-Site
MW-ZN-11S	Monitoring Well	Permanent	On-Site
SW-ZN-1	Surface Water	Lake Michigan	On-Site

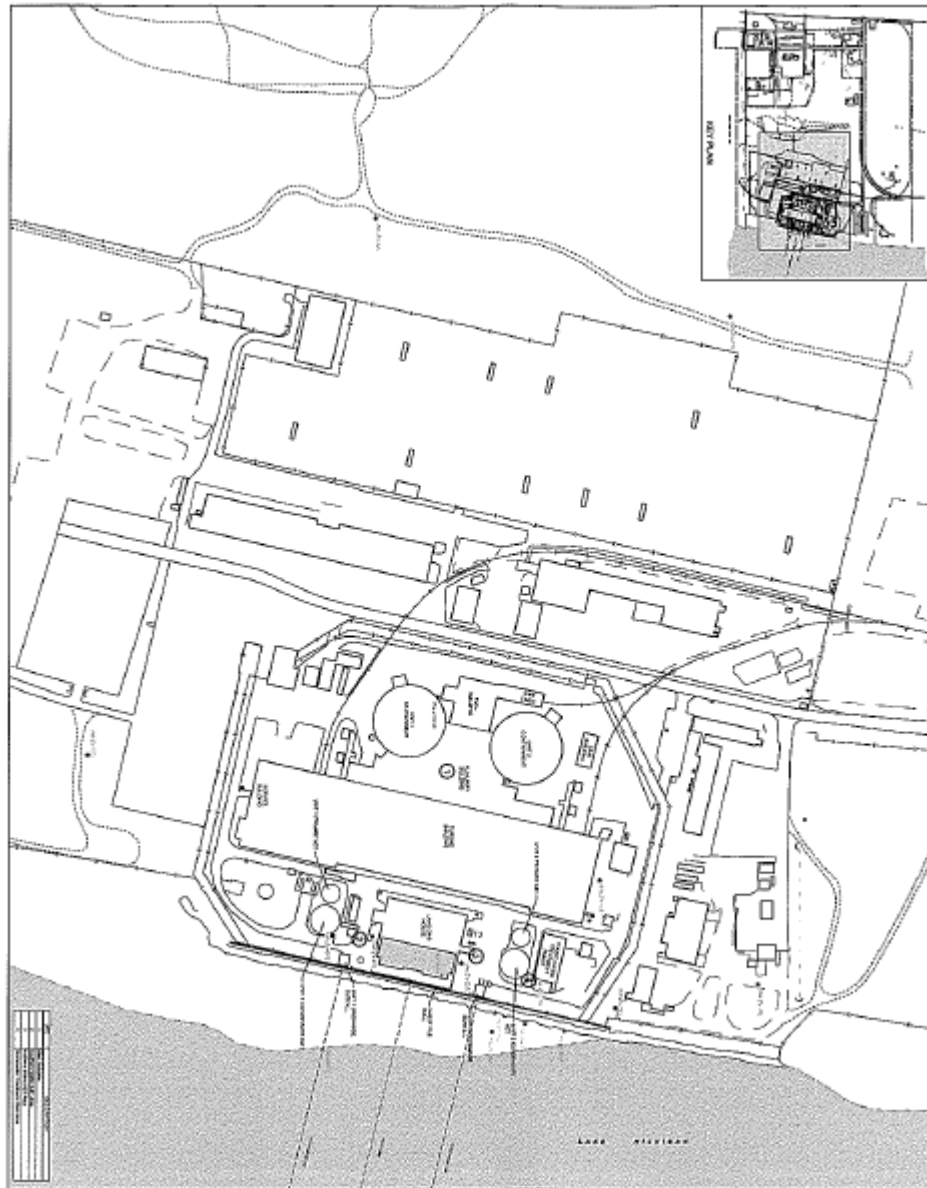


Figure A-1

Radiological Ground Water Protection Program
Groundwater and Surface Water Locations of the Zion Station, 2010

APPENDIX B

DATA TABLES

**TABLE B-I.1 CONCENTRATIONS OF TRITIUM IN GROUNDWATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR STATION, 2010**

RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

SITE	COLLECTION DATE	H-3
MW-ZN-01S	04/07/10	< 180
MW-ZN-01S	09/14/10	< 181
MW-ZN-02S	04/07/10	< 180
MW-ZN-02S	09/14/10	< 177
MW-ZN-03S	04/07/10	< 176
MW-ZN-03S	09/14/10	< 177
MW-ZN-04S	04/07/10	< 183
MW-ZN-04S	09/14/10	< 180
MW-ZN-09S	04/08/10	< 181
MW-ZN-09S	09/14/10	< 177
MW-ZN-10S	04/08/10	< 177
MW-ZN-10S	09/14/10	< 179
MW-ZN-11S	04/08/10	< 180
MW-ZN-11S	09/14/10	< 177

TABLE B-I.2
CONCENTRATIONS OF GAMMA EMITTERS IN GROUNDWATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR STATION, 2010

RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

SITE	COLLECTION PERIOD	Be-7	K-40	Mn-54	Co-58	Fe-59	Co-60	Zn-65	Nb-95	Zr-95	Cs-134	Cs-137	Ba-140	La-140
MW-ZN-01S	09/14/10	< 61	207 \pm 165	< 7	< 5	< 10	< 8	< 13	< 7	< 11	< 4	< 6	< 42	< 8
MW-ZN-02S	09/14/10	< 68	< 59	< 6	< 7	< 16	< 6	< 15	< 8	< 13	< 7	< 8	< 59	< 17
MW-ZN-03S	09/14/10	< 56	117 \pm 113	< 6	< 6	< 15	< 9	< 14	< 8	< 12	< 5	< 7	< 51	< 17
MW-ZN-04S	09/14/10	< 69	< 155	< 7	< 7	< 15	< 7	< 13	< 8	< 13	< 6	< 7	< 53	< 17
MW-ZN-09S	09/14/10	< 42	< 89	< 4	< 5	< 11	< 4	< 9	< 6	< 9	< 4	< 5	< 49	< 16
MW-ZN-10S	09/14/10	< 19	141 \pm 26	< 2	< 2	< 4	< 2	< 4	< 2	< 4	< 2	< 2	< 19	< 6
MW-ZN-11S	09/14/10	< 20	53 \pm 30	< 2	< 2	< 4	< 2	< 4	< 2	< 4	< 2	< 2	< 22	< 7

**TABLE B-II.1 CONCENTRATIONS OF TRITIUM IN SURFACE WATER SAMPLES
COLLECTED IN THE VICINITY OF ZION NUCLEAR STATION, 2010**

RESULTS IN UNITS OF PCI/LITER \pm 2 SIGMA

SITE	COLLECTION DATE	H-3
SW-ZN-1	04/07/10	< 180
SW-ZN-1	09/14/10	< 178

